
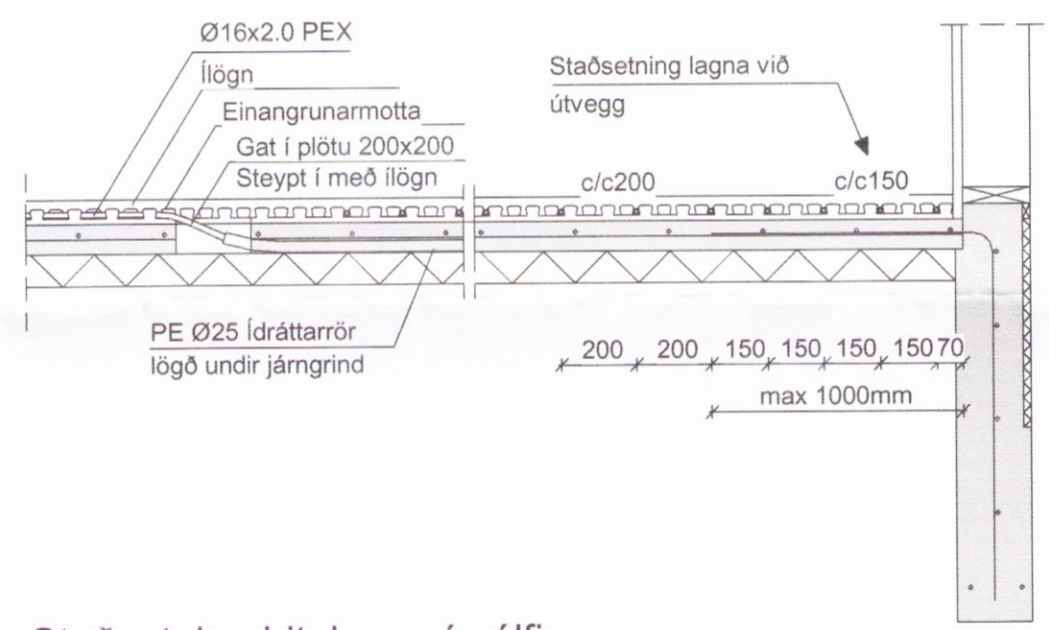
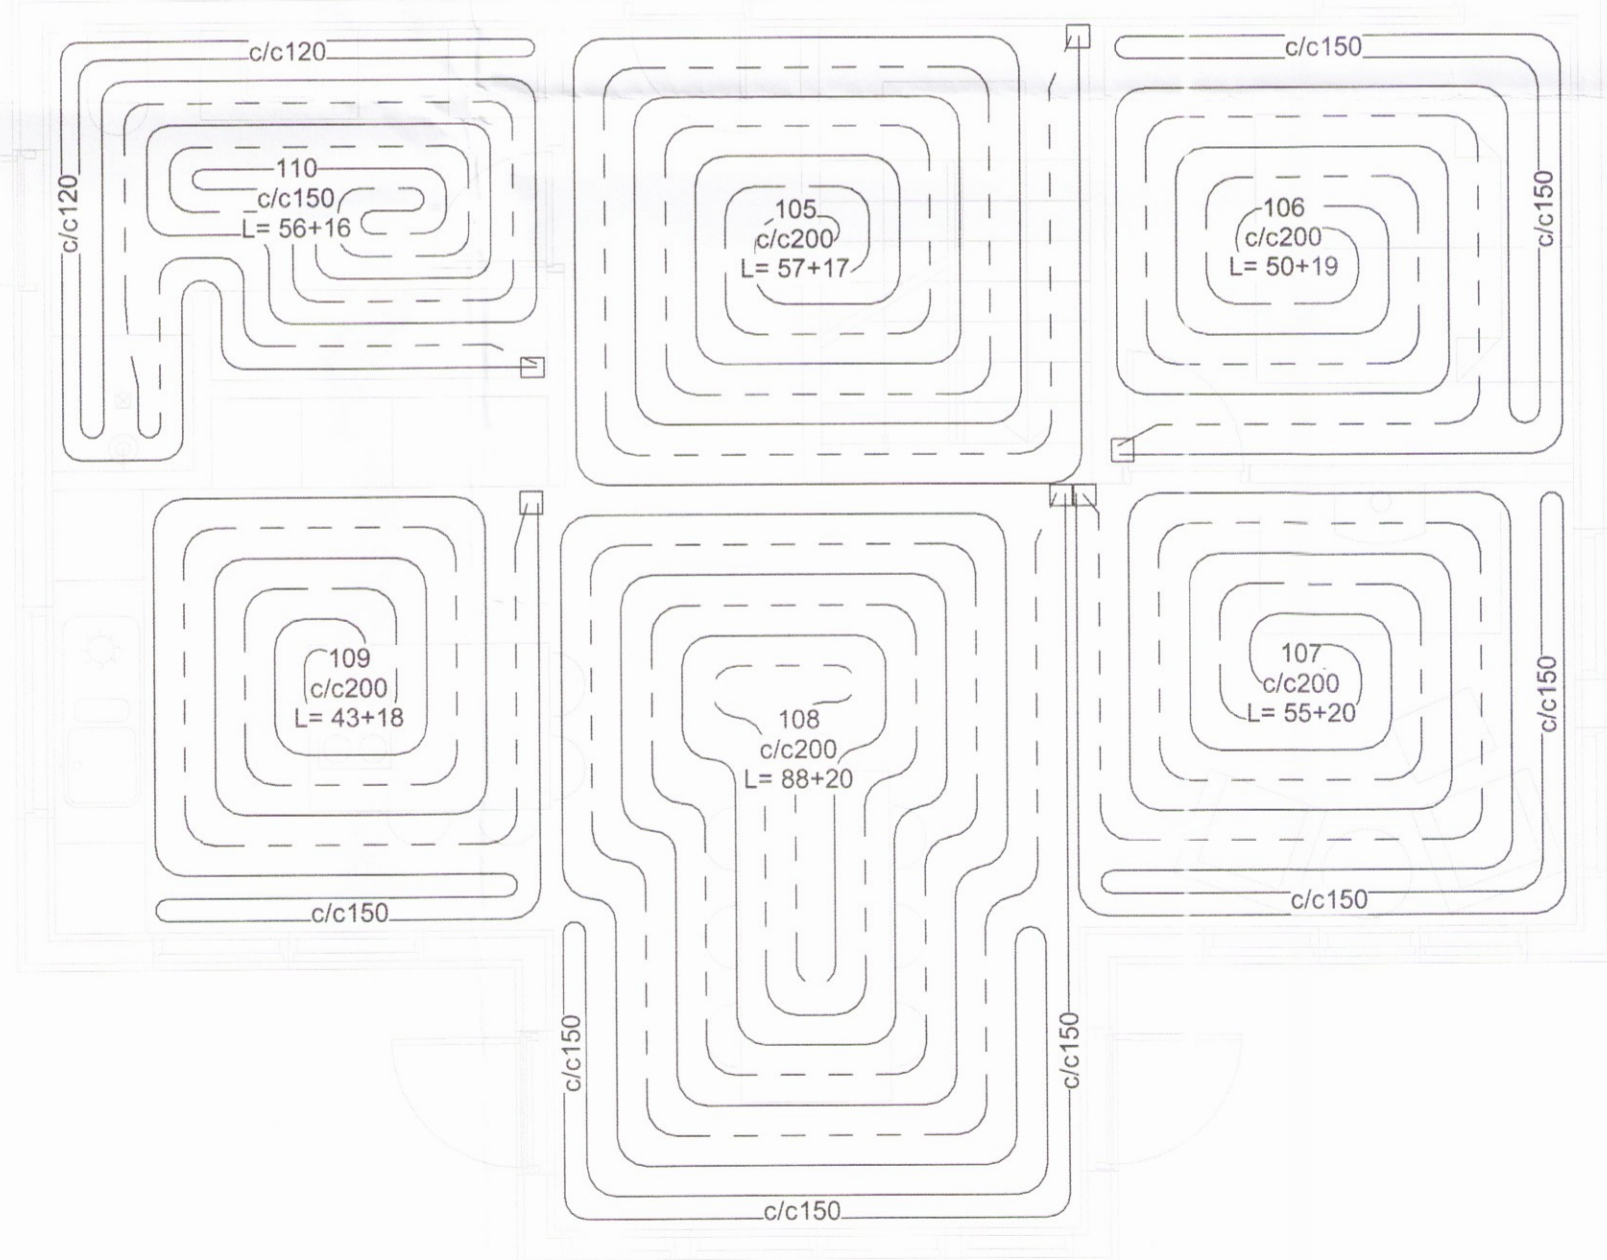
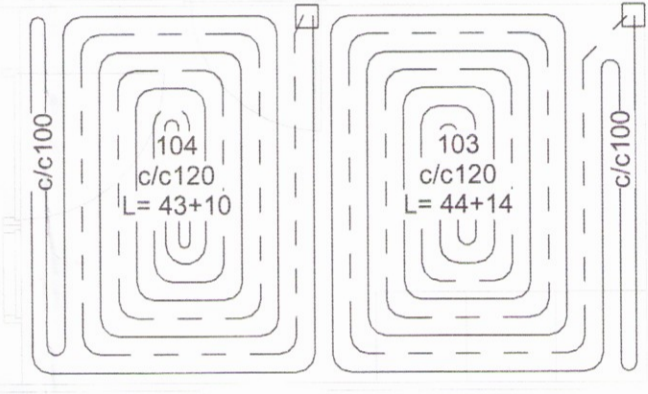


Lengd á gólfhitalögnum 1.hæð			
Slaufa nr:	Staðsetning:	Afköst,þörf(W):	Lengd lm.:
101	Bilgeymsla	1.952	93+2
102	Bilgeymsla	1.952	92+1
103	Anddyri	672	44+14
104	Anddyri	672	43+10
105	Gangur/Stigi	522	57+17
106	Herbergi	836	50+19
107	Alrými	1.668	55+20
108	Alrými	1.668	88+20
109	Eldhús	1.102	43+18
110	Bað/þvottur	802	56+16
Samtals		11.846	623+137


Skipulags- og byggingarfulltrúi Uppsveita bs.  
**Yfirfarið**  
 25. jan. 2017  
*[Signature]*  
 Byggingarfulltrúi

ADALHÖNNUÐUR

Útg. Dags. Skýring Br.af: Yfirf.

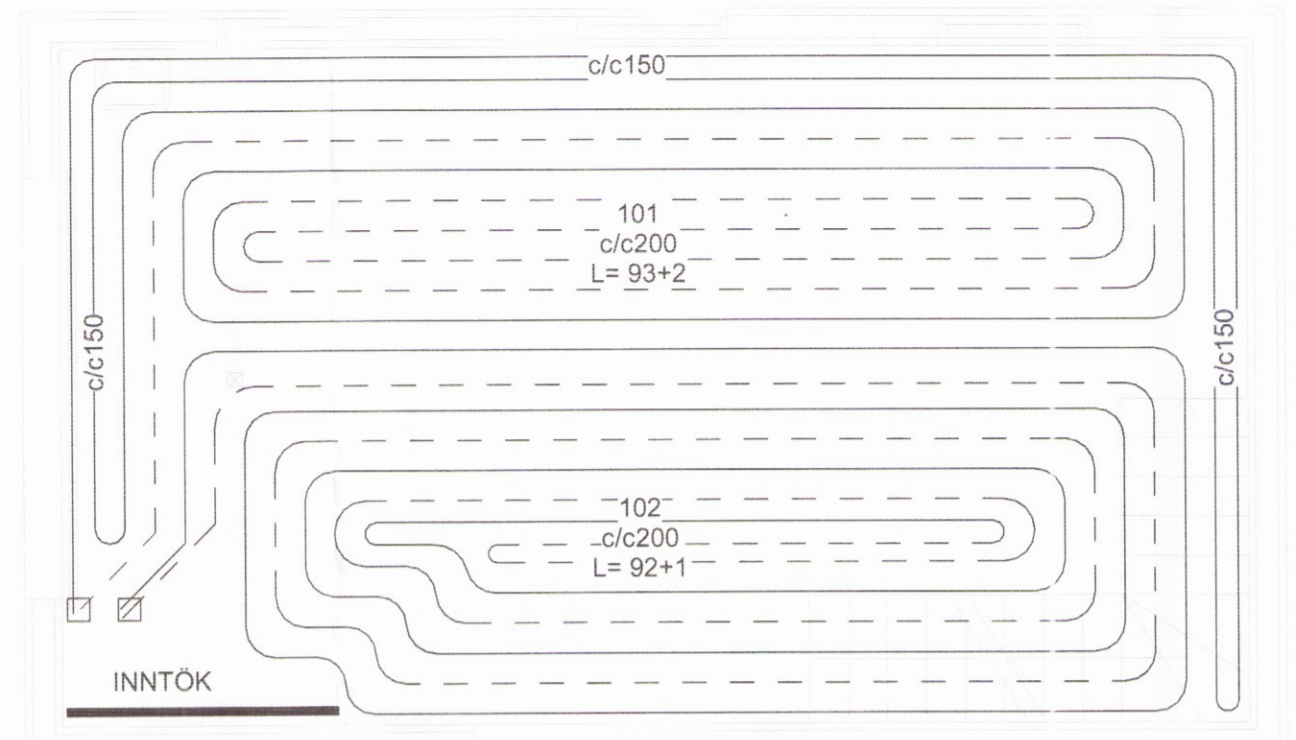


Staðsetning hitalagna í gólfi  
1 : 20

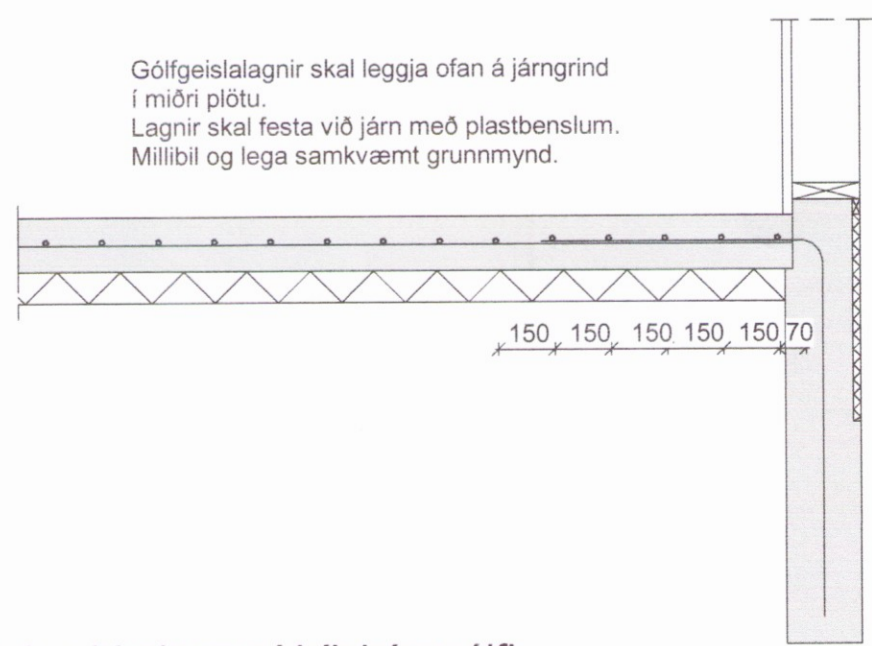

Staðsetning hitalagna í bílskúrgólfi  
1 : 20

Gólfhitalagnir 1.hæð  
1 : 50

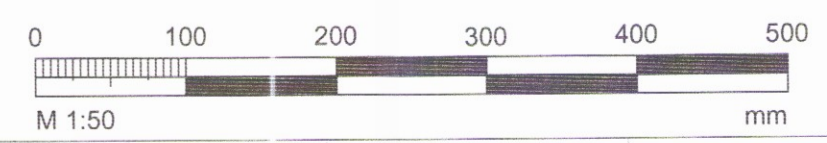

**EFLA**  
 VERKFRÆÐISTOFA  
 sími 412 6000 www.efla.is

**Öndverðanes 2**  
 Fristundarhús  
 801 Selfoss

Lagnir  
 Gólfhitalagnir 1.hæð  
 Grunnmynd, tafla og snið

TEIKNUNÚMÉR	BLADSTÆRÐ	HANNAÐ:	JS
5182-001	A2	TEIKNAD:	JS
01_2_43_02		YFIRFARIÐ:	GH
DAGS.	MÆLIKVARÐI	ÚTGÁFA	
12.12.2016	1:50/1:20	<b>A</b>	

SAMÞYKKT: *[Signature]*  
 KENNITALA: Guðmundur Hjaltason Kt: 070966-5579