

GÓLFHITATAFLA / Hestvíkurvegur 24


Slauts nr.	Staðsetning	Alkóst á W/m ²	Fermetrar m ²	Alkóst W	Yfirborðshiti °C	Lengd m	Bí milli róra mm	Hitafalli í slautu °C	Rennsli í slautu l/min	Þvermál pípu (DN) mm	Hraði í slautu m/s	Þrystifall kPa	Tengistaður	Stýring
01	Herbergi kj.	94	11	1.032	31	84	200	10	1.5	15	0.1	35	1	HN1
02	Anddyrt	107	7	750	32	56	200	10	1.1	15	0.1	59	1	HN2
03	Herbergi Kj	94	12	1.125	31	66	200	10	1.6	15	0.2	78	1	HN3
04-01	Bátageymsla	60	45	2.695	23	120	200	6	7.0	15	0.6	26	1	HN3
04-02	Bátageymsla	60	45	2.695	23	120	200	6	7.0	15	0.6	26	1	HN3
101	Herbergi lýðna	94	10	938	31	42	200	10	1.3	15	0.1	37	2	HN101
102	Bað	107	4	426	32	12	200	10	0.6	15	0.1	50	2	HN102
103-1	Stofa	93	27	2.800	28	105	200	10	4.5	15	0.4	33	2	HN103
103-2	Stofa	93	27	2.900	28	127	200	10	4.5	15	0.4	33	2	HN103
104	Hól/Abbdýrt	94	11	1.032	31	35	200	10	1.5	15	0.1	20	2	HN104
105	Bað	107	5	536	31	18	200	10	0.8	15	0.1	36	2	HN105
106	Herbergi	94	8	750	32	35	200	10	1.1	15	0.1	48	2	HN106
107	Herbergi	94	11	1.032	31	47	200	10	1.5	15	0.1	65	2	HN107
Samtals		223,0		18.710		867								

Alkóst samtals: 15 kW
Rennsli samtals: 0,6 l/sek
Mesta Þrystifall: 78 kPa

Alkóst á deiliskistu 1: 8 kW
Rennsli á deiliskistu 1: 0,3 l/sek
Mesta Þrystifall á deiliskistu 1: 78 kPa


Alkóst á deiliskistu 2: 10 kW
Rennsli á deiliskistu 2: 0,3 l/sek
Mesta Þrystifall á deiliskistu 2: 65 kPa

FALLPÍPUR 1/50

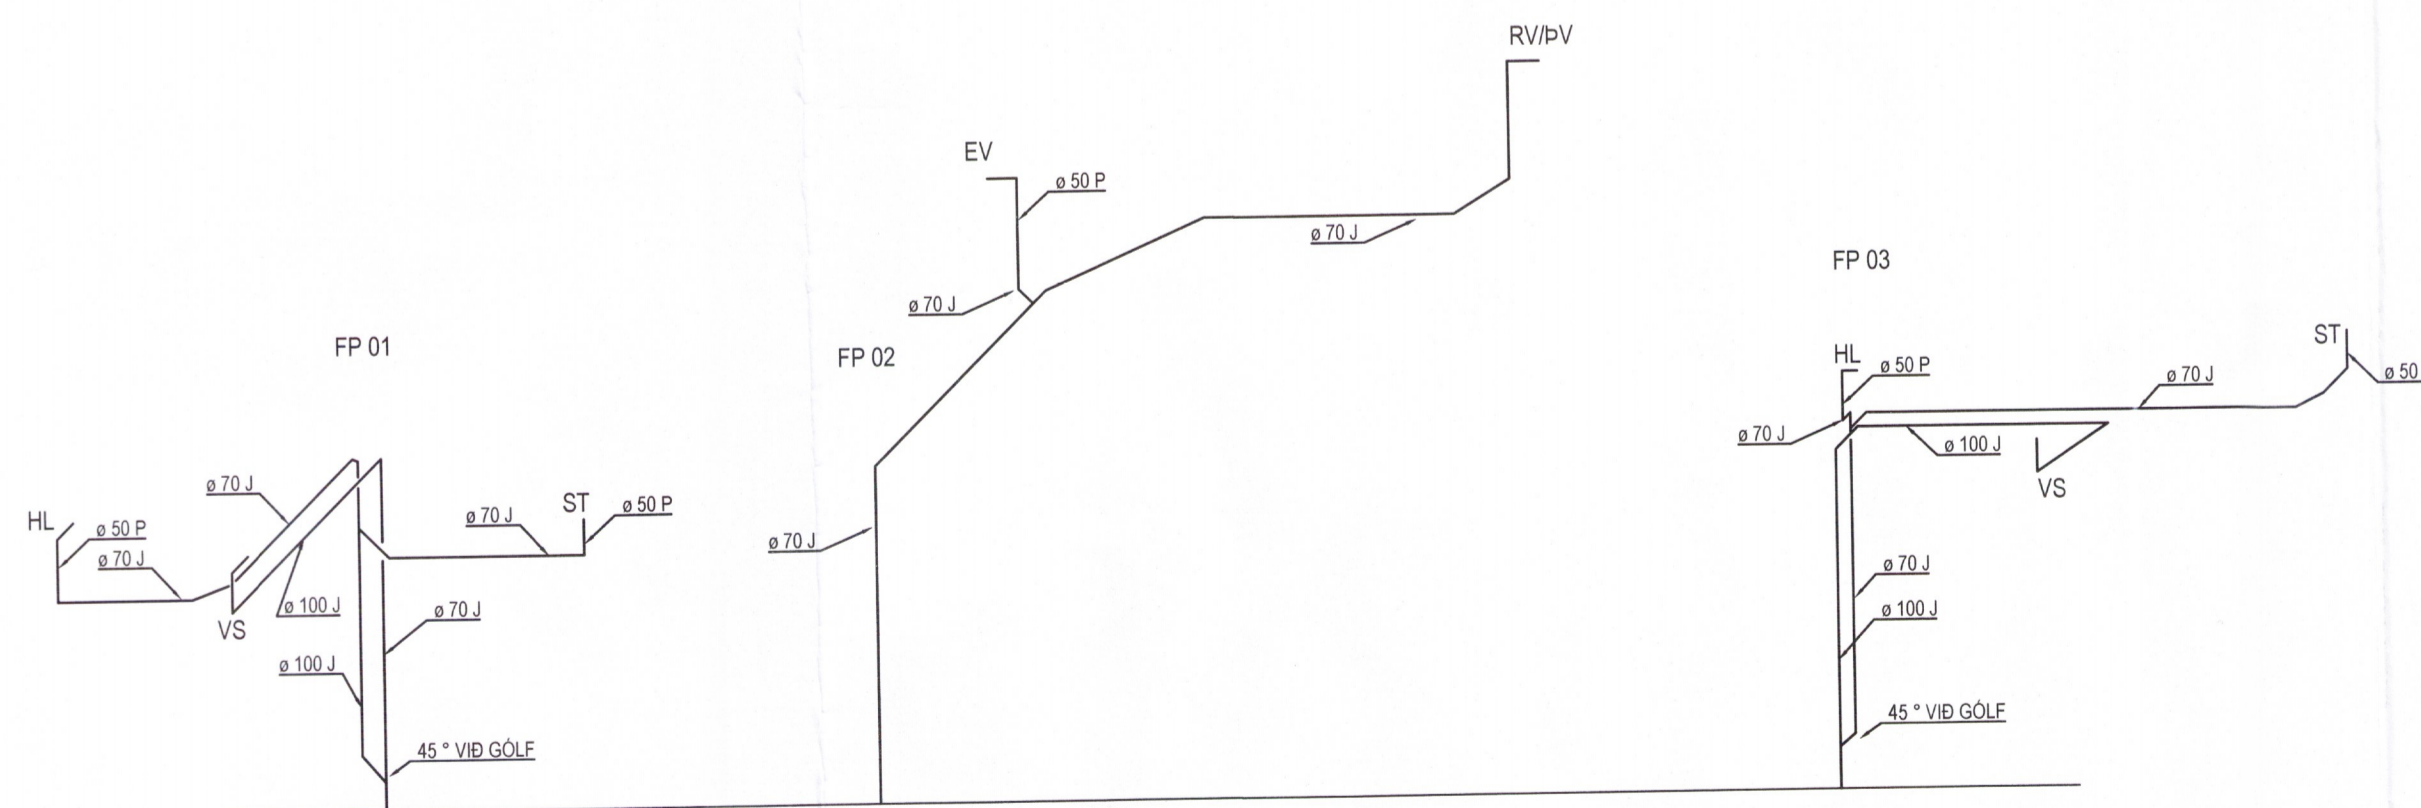

Handwritten signature

Hestvíkurvegur 24
Hestvík, Nesjar
Grímsnes og Grafningshreppur
Tengigrind
Fallstammar og gólfhitaskrá

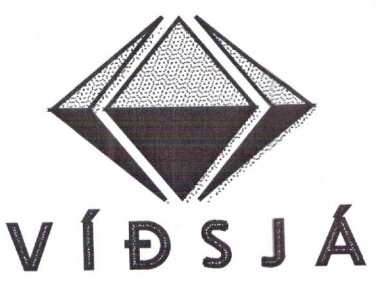

VERKFRÆÐISTOFA FRV
TRYGGVAGATA 11, 101 REYKJAVÍK
Sími: 561 9040, NETFANG: vidsja@vidsja.is
www.vidsja.is

HAFFND	AB	TEKNI	AB	MKV	1/50	VERNR	16-082
SKR	AB	SKR	16-085	Lagfr		TEKN. NR.	
UTGÁFA		DAGS	20.11.2017				P 04