
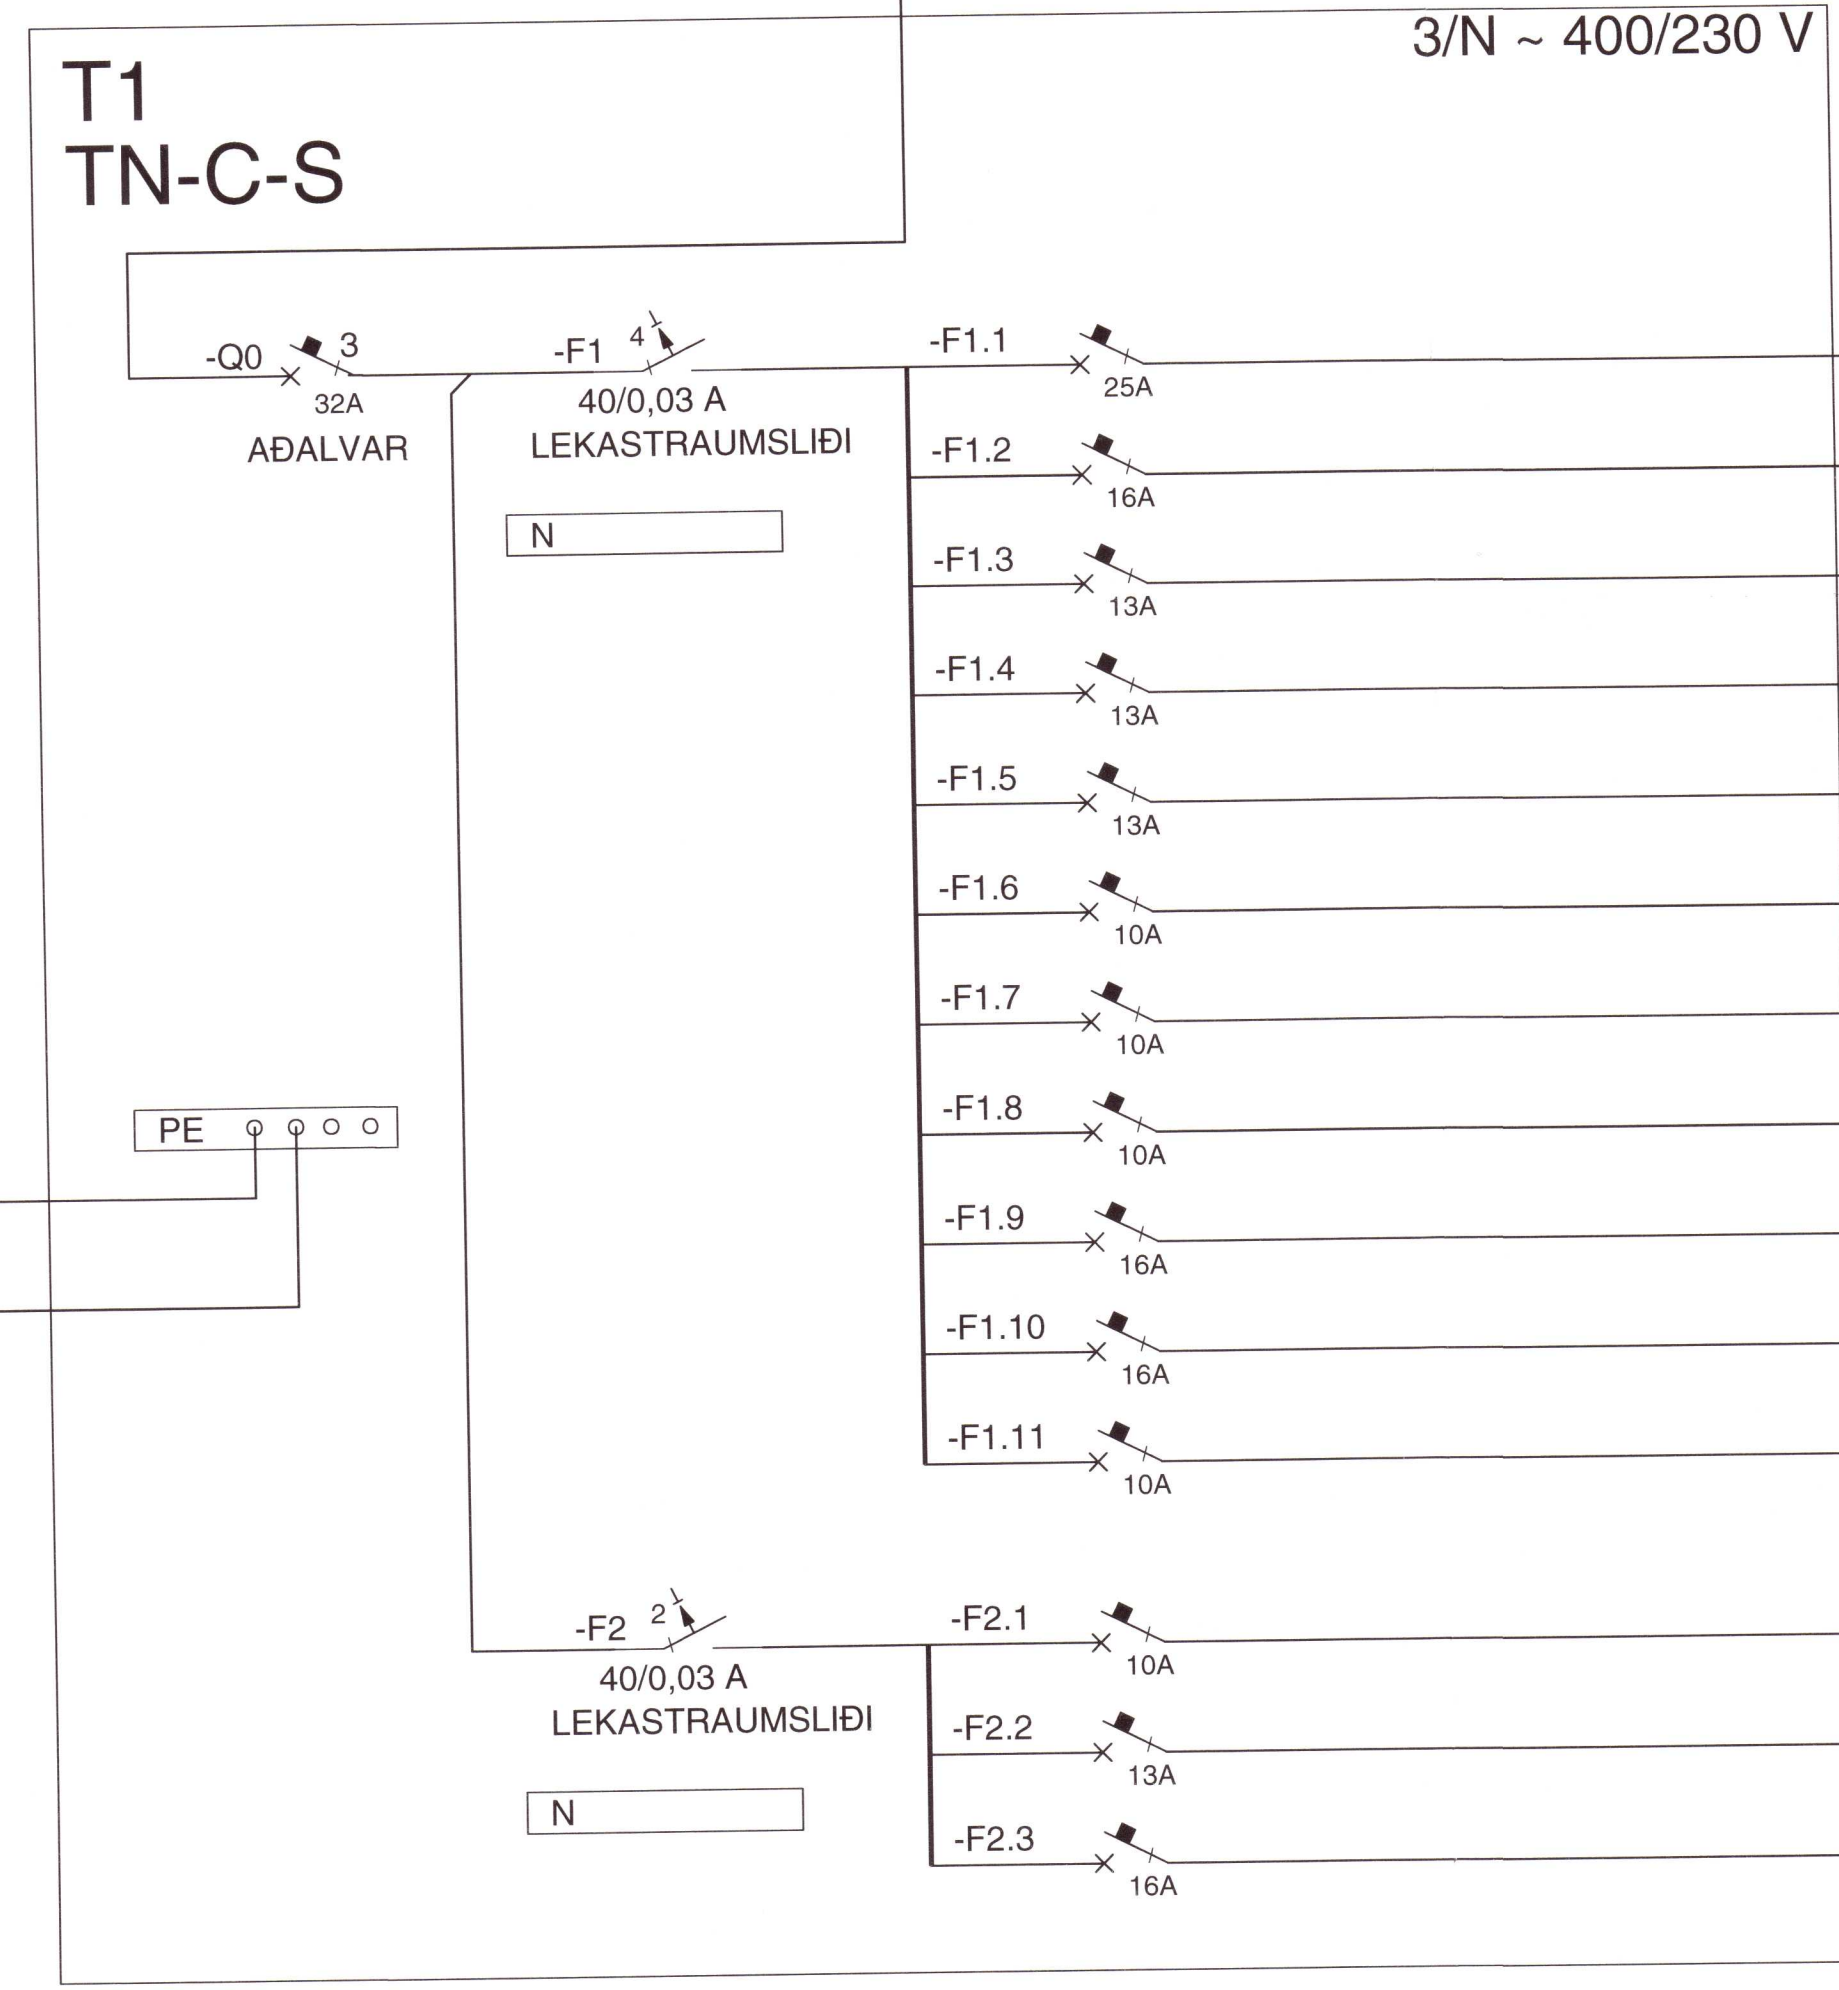


STOFN FRÁ RAFVEITU
3/N ~ 400/230 V

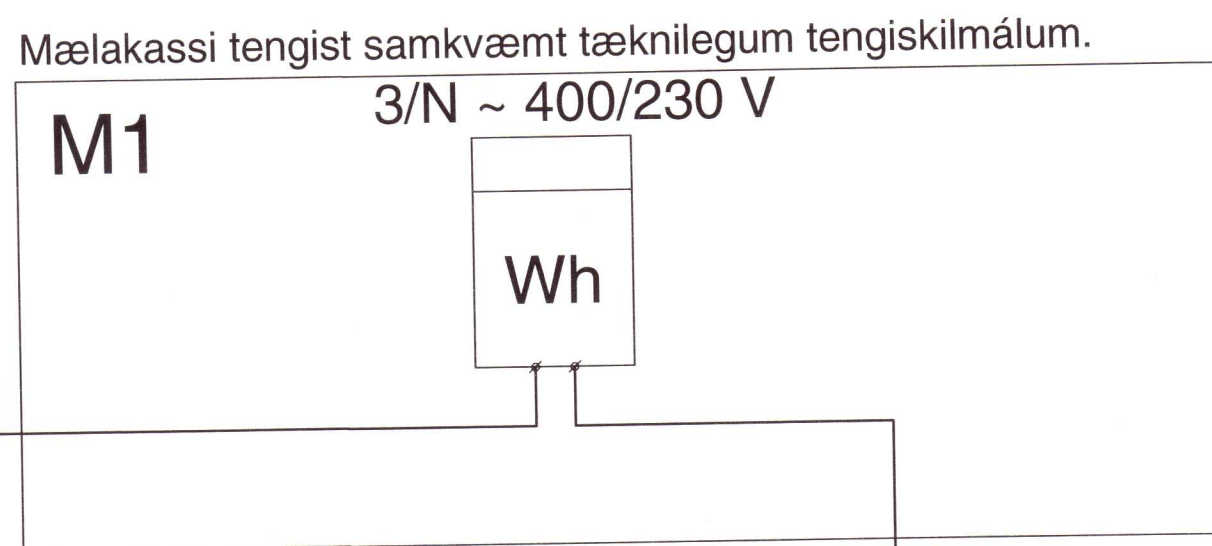

16 mm² VÍR Í JÖRÐU

6 mm² VS, STURTA

PE

N

N

-F1.1	25A	///	NYM	3x4 mm ²	ELDAVÉL ELDHÚS
-F1.2	16A	///	NYM	3x1,5 mm ²	VINNUTENGILL SÉRTENGILL
-F1.3	13A	///	NYM	3x1,5 mm ²	OFN ELDHÚS
-F1.4	13A	///	NYM	3x1,5 mm ²	KÆLIR, SÉRTENGLAR ELDHÚS
-F1.5	13A	///	NYM	3x1,5 mm ²	LJÓS, TENGLAR ELDHÚS
-F1.6	10A	///	NYM	3x1,5 mm ²	LJÓS, TENGLAR STOFA
-F1.7	10A	///	NYM	3x1,5 mm ²	HITATÚPA RAFHITUN
-F1.8	10A	///	NYM	3x1,5 mm ²	LJÓS, TENGLAR 2 HERBERGI
-F1.9	16A	///	NYM	3x2,5 mm ²	PURRKARI PVOTTAHÚS
-F1.10	16A	///	NYM	3x2,5 mm ²	PVOTTAVÉL PVOTTAHÚS
-F1.11	10A	///	NYM	3x1,5 mm ²	LJÓS, TENGLAR PV.HÚS, BAÐ, ÚTILJÓS
-F2.1	10A	///	NYM	3x1,5 mm ²	LJÓS, TENGLAR ÚTISVÆÐI
-F2.2	13A	///	NYM	3x1,5 mm ²	LJÓS, TENGLAR VINNUSKUR
-F2.3	16A	///	NYM	3x2,5 mm ²	TIL VARA

Umhverfis- og tæknisvið Uppsveita
Yfirfarið
25 MAY 2021
Byggingarfulltrúi

BREYTINGAR				
ÚTG.	DAGS.	BREYTING	HA.	YF.
VERKHLUTI				
RAFLAGNIR EINLÍNUMYND				
KVARDI				
HIANNAD	TEIKNAD	YFIR	ÚTGÁFA	
GPR	GPR			
VERKKAUPI				
20211107				
GÖTUHEITI				
FRAMNES, FASTNR. 166511				
STADUR				
SKEIDA- OG GNÚPVERJAHREPPUR				
Gísli Þór Ragnarsson				
RAFLAGNAHÖNNUÐUR				
Kambaseli 69, 109 Reykjavík				
TEIKNING NR. S-FRA01.1	BLAD NR. 1	N. BLAD NR. 2		
DAGS. 26.04.21	VERK NR. S-FRA01			
SAMP.	KENNI.	040367-5789		