




GLUGGAR M.K. 1/25

Umhverfis- og tæknisvið Uppsveita
Samþykkt
 18. maí 2022
David Þorvaldur
 Byggingarfulltrúi

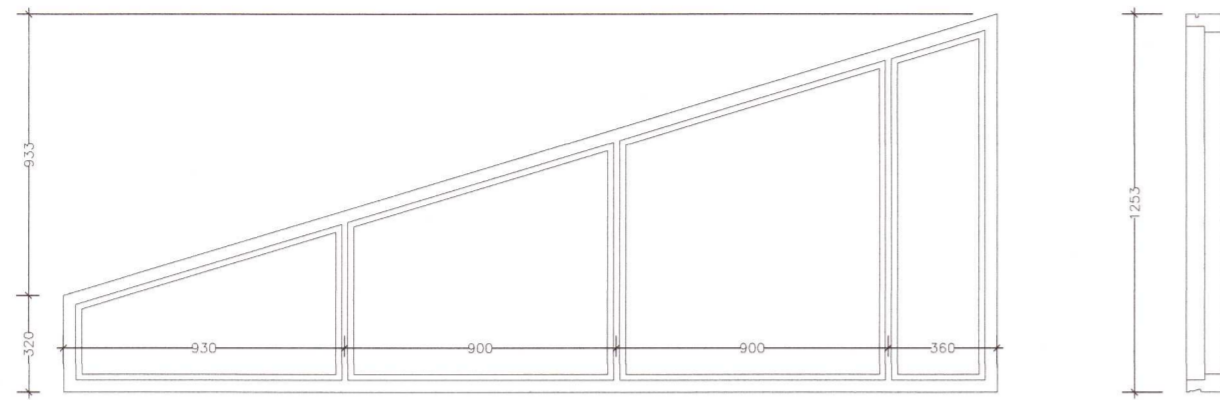



G1 1 stk. (gafi)

fl.mál: 2,43 m²
 ummál (karmar): 7,89 m. póstar: 2,40 m.

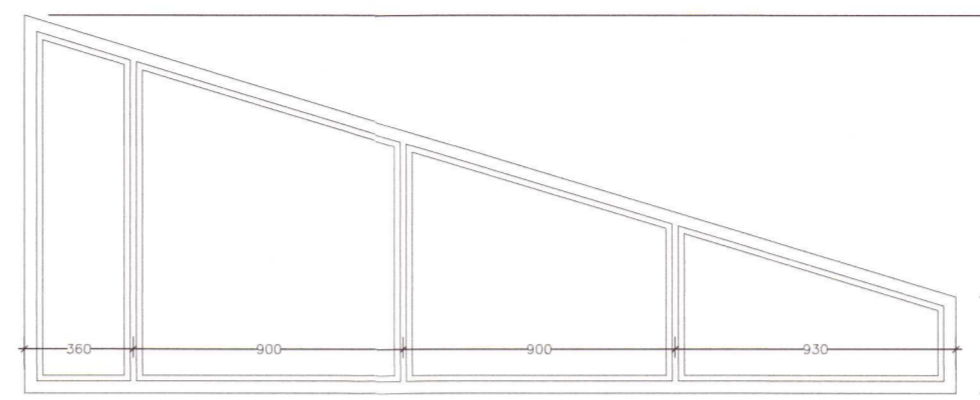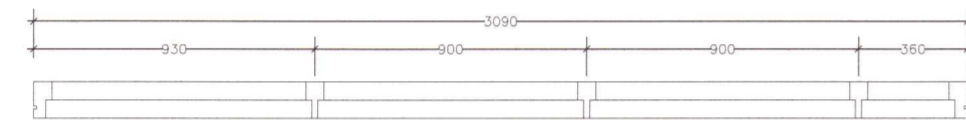



G2 1 stk. (gafi)

fl.mál: 2,43 m²
 ummál (karmar): 7,89 m. póstar: 2,40 m.

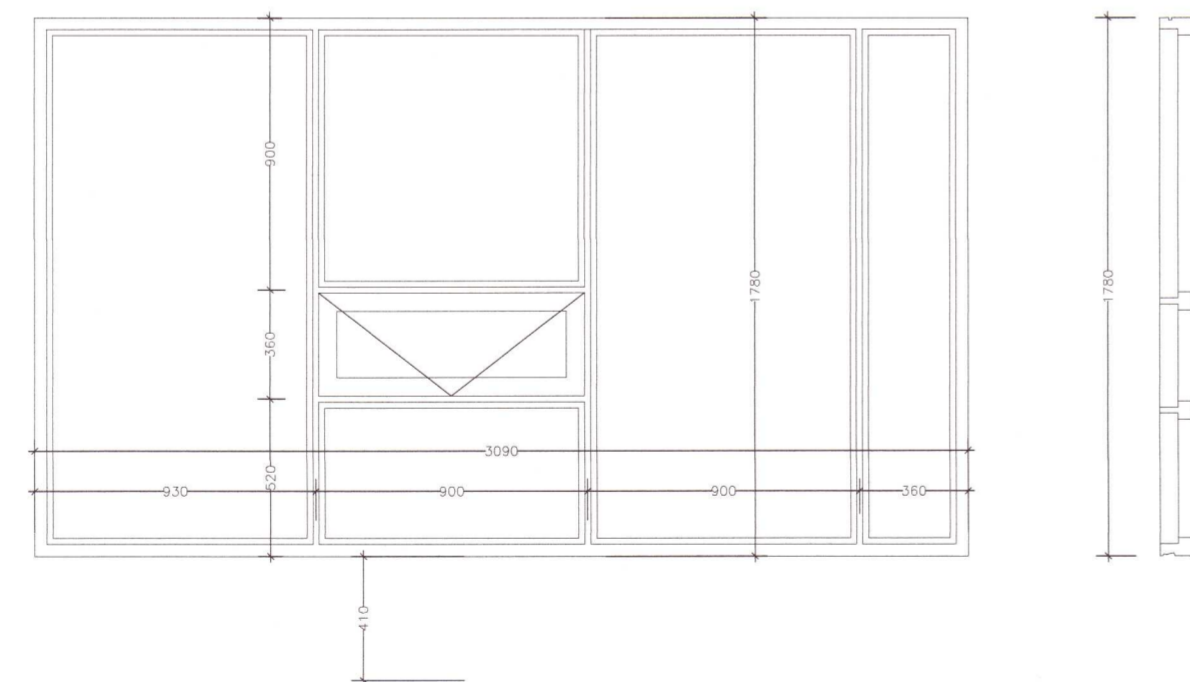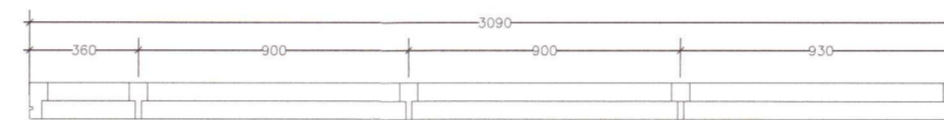


G3 1 stk. (gafi)

fl.mál: 5,50 m²
 ummál: 9,74 m. póstar: 7,14 m, grindur: 2,52 m.

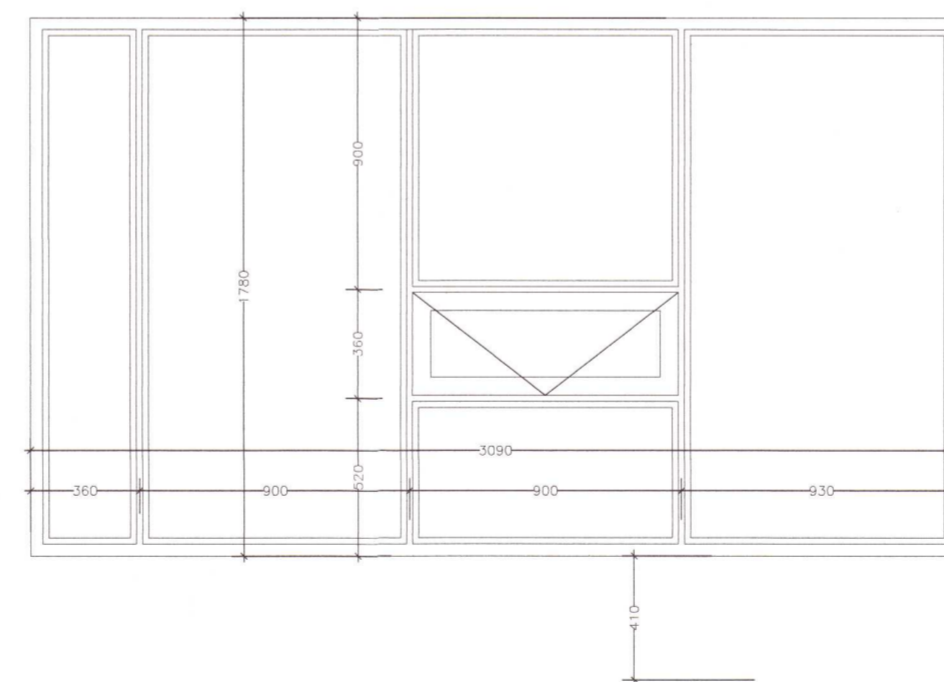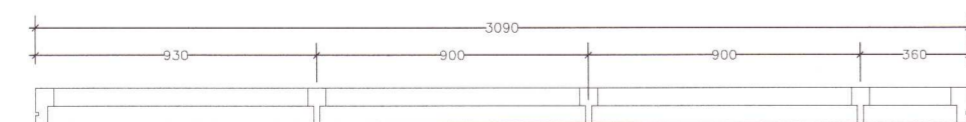

G4 1 stk. (gafi)

fl.mál: 5,50 m²
 ummál: 9,74 m. póstar: 7,14 m, grindur: 2,52 m.

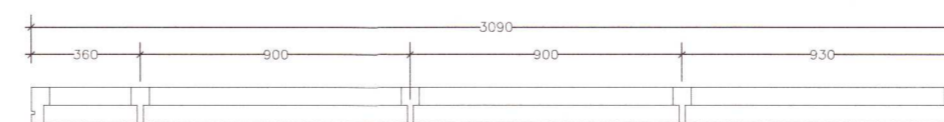

SKÝRINGAR

Gluggar skulu vera af viðurkenndri gerð. Gluggaframleiðandi skal uppfylla styrkleikakröfur og kröfur um hámarkssvignun gluggapósta. Gler skal vera háeinangrandi K-gler. Öryggisgler skal vera í glerhurðum og gluggum þar sem hæð nær ekki 0,6m frá gólfi sbr. gr. 8.5.2 í byggingarreglugerð 112/2012

20220890