

## Brekkugerði 1.hæð

Varmatap, ofnaskrá – Samantekt

Herbergi	Heiti	Rými nr.	Slauða nr.	Gólfefni	Varmatap W	Varmatap Kcal/klst	atnsmag I/s	Valinn ofn h=600	Ofn nr.	Péttleiki mottu í d mitt gólf við glugga	Slöngulengd samtals m	Varmagjöf W	
Anddyri stofa íbúð húseiganda		101	1-2	Flísar	2232	1919	0,089			100	75	154	2251
Herbergi íbúð húseiganda		102			535	460	0,005	11-1200	1.02				881
Bað/þvottur íbúð húseiganda		103	3	Flísar	276	238	0,022			150	75	70	544
Vinnuherbergi íbúð húseiganda		104			405	349	0,003	11-800	1.04				587
Salerni miðrymi		105			298	256	0,003	11-800	1.05				587
Móttaka miðrymi		106			959	825	0,004	11-1000	1.06 a				734
Móttaka miðrymi		106					0,029	11-1000	1.06 b				734
Anddyri		107			300	258	0,003	11-800	1.07				587
Sameiginlegt þvottahús		108			262	225	0,003	11-800	1.08				587
Eldhús 1. hæð		109			1130	972	0,010	11-2200	1.09				1614
Baðherbergi starfsmanns		110			464	399	0,004	11-900	1.10				660
Íbúð starfsmanns		111			873	750	0,008	11-1800	1.11				1320
Sólskáli			4-5		1500		0,060			100	100	192	1520
Stétt vestanvert snjóbræðsla			6							200		55	

Samtals 7.734 6.651 0,09 224 12.606

Framrás ofna 85°C Framrás gólfhita 45°C  
dT 40 °C dT 6 °C


## Brekkugerði 2.hæð

Varmatap, ofnaskrá – Samantekt

Herbergi	Heiti	Nr	Slauða nr.	Gólfefni	Varmatap W	Varmatap Kcal/klst	atnsmag I/s	Valinn ofn h=600	Ofn nr.	Péttleiki mottu í d mitt gólf við glugga	Slöngulengd samtals m	Varmagjöf W
Baðherbergi		201			227	195	0,0035	11-800	2.01			587
Baðherbergi		202			182	157	0,0035	11-800	2.02			587
Herbergi		203			1010	869	0,0087	11-2000	2.03			1467
Gangur		204			492	423	0,0052	11-1200	2.04			881
Herbergi		205			685	589	0,0061	11-1400	2.05			1027
Baðherbergi		206			244	210	0,0035	11-800	2.06			587
Baðherbergi		207			129	111	0,0035	11-800	2.07			587
Herbergi		208			671	577	0,0061	11-1400	2.08			1027
Herbergi		209			901	775	0,0083	22-1000	2.09			1402
Setustofa		210			892	767	0,0044	11-2000	2.10a			734
Setustofa		210					0,0044	11-2000	2.10b			734
Herbergi 6		211			901	775	0,0079	11-1800	2.11			1320
Herbergi 7		212			1074	924	0,0087	11-2000	2.12			1467
Gangur		213			145	125	0,0035	11-800	2.13			587
Herbergi 8		214			1083	931	0,0061	11-1400	2.14a			1027
Herbergi 8		214					0,0035	11-800	2.14b			587
Baðherbergi		215			92	79	0,0022	11-500	2.15			367
Baðherbergi		216			235	202	0,0035	11-800	2.16			587
Herbergi		217			563	484	0,0052	11-1200	2.17			881
Baðherbergi		218			298	256	0,0035	11-800	2.18			587
Stigagangur		219			444	382	0,0039	11-900	2.19			660
Verönd snjóbræðsla			7							200		19

Samtals 2.596 8.830 0,11 0 17.690

Framrás 85°C  
dT 40 °C

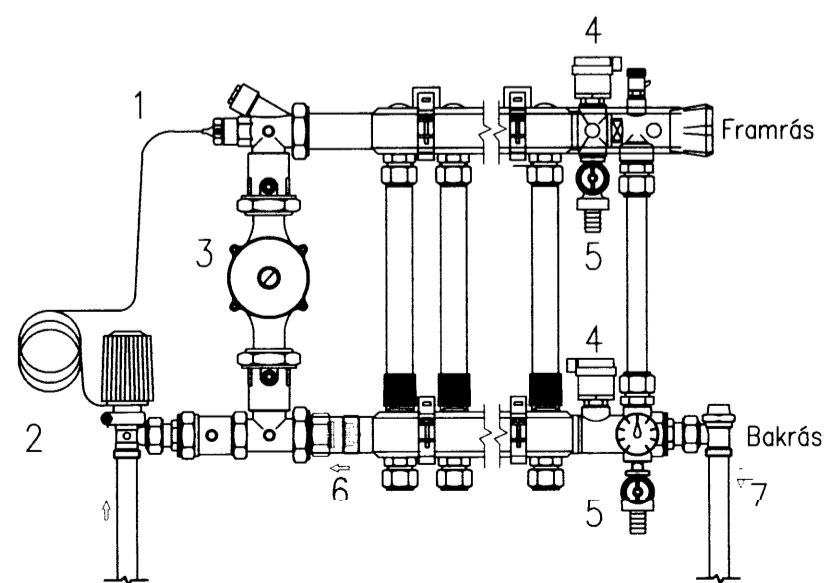

1. Hitanemi í framrás
2. Framrásarloki, stýrir hitastigi í framrás.
3. Deila, þriggja þrepa
4. Loftteming
5. Temiloki
6. Einstreymisloki
7. Bakrás gólfhita

KISTA FYRIR GÓLFHITA

0 1000 5000 mm



www.verkis.is - sími: +354 422 8000

SAMÞYKKT:

F.h. VERKÍS Ari Guðmundsson 150773-5556

A 2015-11-09 Verkteikning AJ AJ AAA ArG

ÚTG DAGS SKÝRINGAR TEIK HANN RÝNT SAMÞ

BREKKUGERÐI

AUSTURBYGGÐ 20, LAUGARÁSI 801 SELFOSS  
Ofnatöflur, tengigrindu, mælagrind.

1. og 2. hæð

VERKFANG 15222 TEIKNING

M43.001 A