
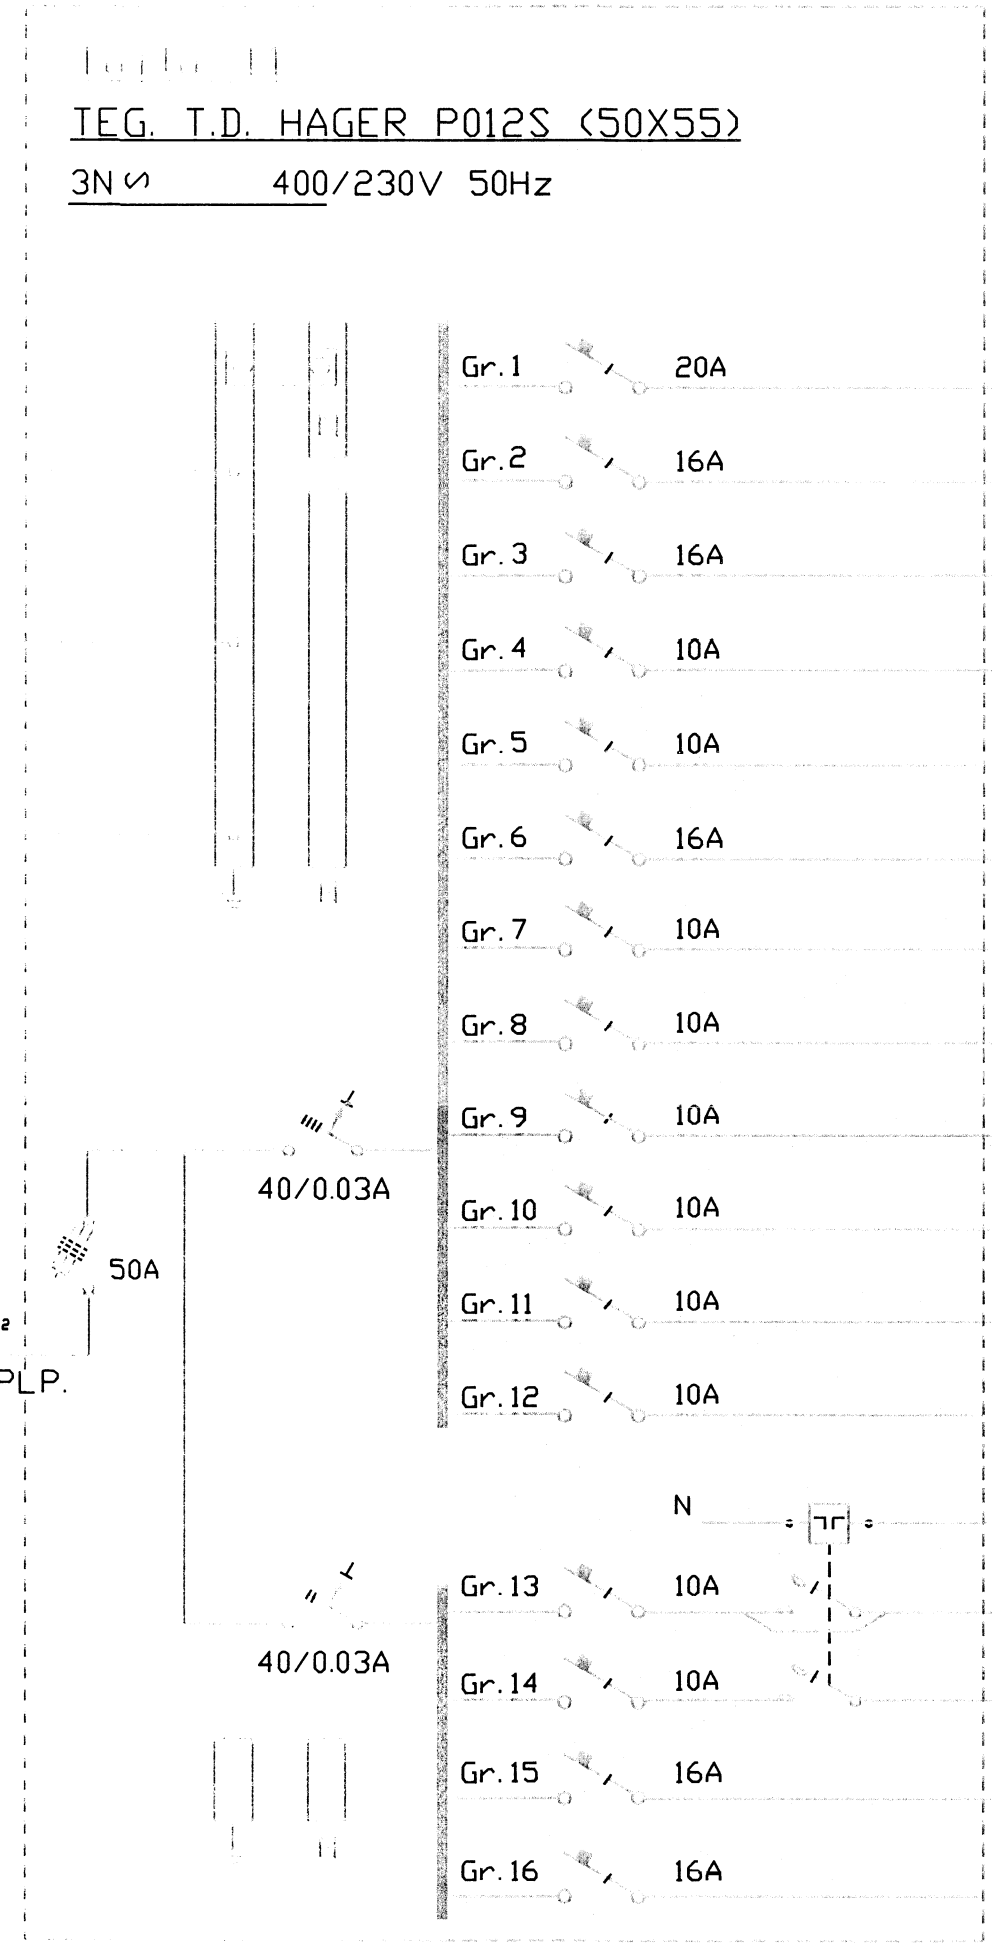
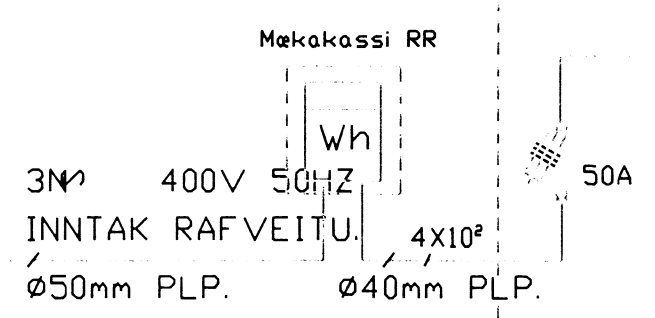


*Handwritten signature*

TEG. T.D. HAGER P012S (50X55)  
 3N 400/230V 50Hz

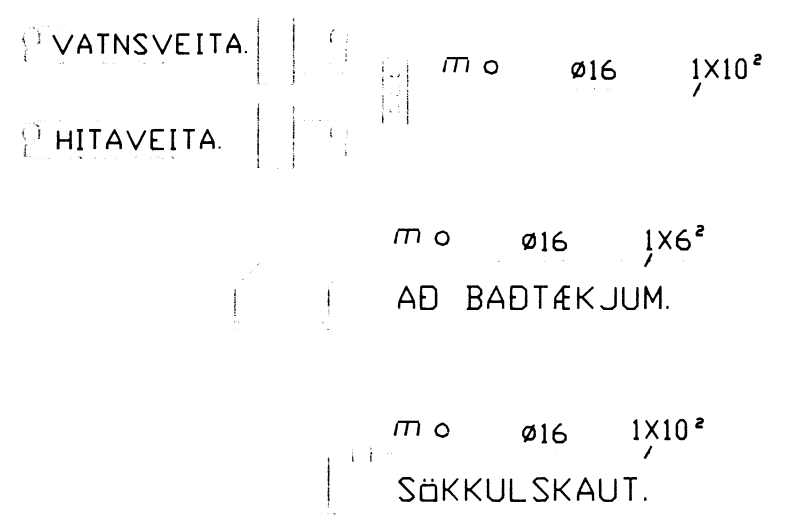

MKV. ENGINN

Group	Rating	Cable	Destination
Gr. 1	20A	m o ø20 3 4²	Eldavél
Gr. 2	16A	m o ø16 3 2,5²	Tenglar Eldhúsi
Gr. 3	16A	m o ø16 3 2,5²	ÖRBYLGJUÖFN
Gr. 4	10A	m o ø16 3 1,5²	UPPÞVOTTAVÉL
Gr. 5	10A	m o ø16 3 1,5²	ÞVOTTAVÉL
Gr. 6	16A	m o ø16 3 2,5²	ÞURRKARI
Gr. 7	10A	m o ø16 3 1,5²	Eldhús og Stofa
Gr. 8	10A	m o ø16 3 1,5²	Bað og Herbergi
Gr. 9	10A	m o ø16 3 1,5²	Gangur, Andd og Svefnloft
Gr. 10	10A	m o ø16 3 1,5²	Hjón, VS og Inntök
Gr. 11	10A	m o ø20 3 2,5²	Gólfhiti
Gr. 12	10A		Til Vara
Gr. 13	10A	m o ø16 3 1,5²	Ljóssemi/sólúr
Gr. 14	10A	m o ø20 3 2,5²	Útilýsing og Tenglar
Gr. 15	16A	m o ø20 3 2,5²	Möguleg garðlýsing
Gr. 16	16A		Mögulegt Garðhús
			Til Vara

NR	Breytingar	Dags.
A		
B		
C		

SUMARHÚS

Höfsvík 11  
 GRÍMSN. GRAFNINGS.

*Handwritten signature*

EINLÍNEMYND TÖFLU  
 TEINN SKRÁ: 20150722 HEIDARBR 15 EINLÍNEMYND TÖFLU ENGINN SCALI

DAGS: 22.07.2015  
 Tæknipjónusta lyngmóil@gmail.com GSM 821 - 3990

**Alberts**

Albert Eóvaldsson Rafmagnstæknifr. Bsc TEIKN: 5 AF 5  
 260564-4639 Lyngmói 1, 260 Njaróvík

8384