


MÓTTAKIÐ
 02.06.2011
 Ragnars Gunnarsson

VARMASKIPTIR HEITTS VATNS

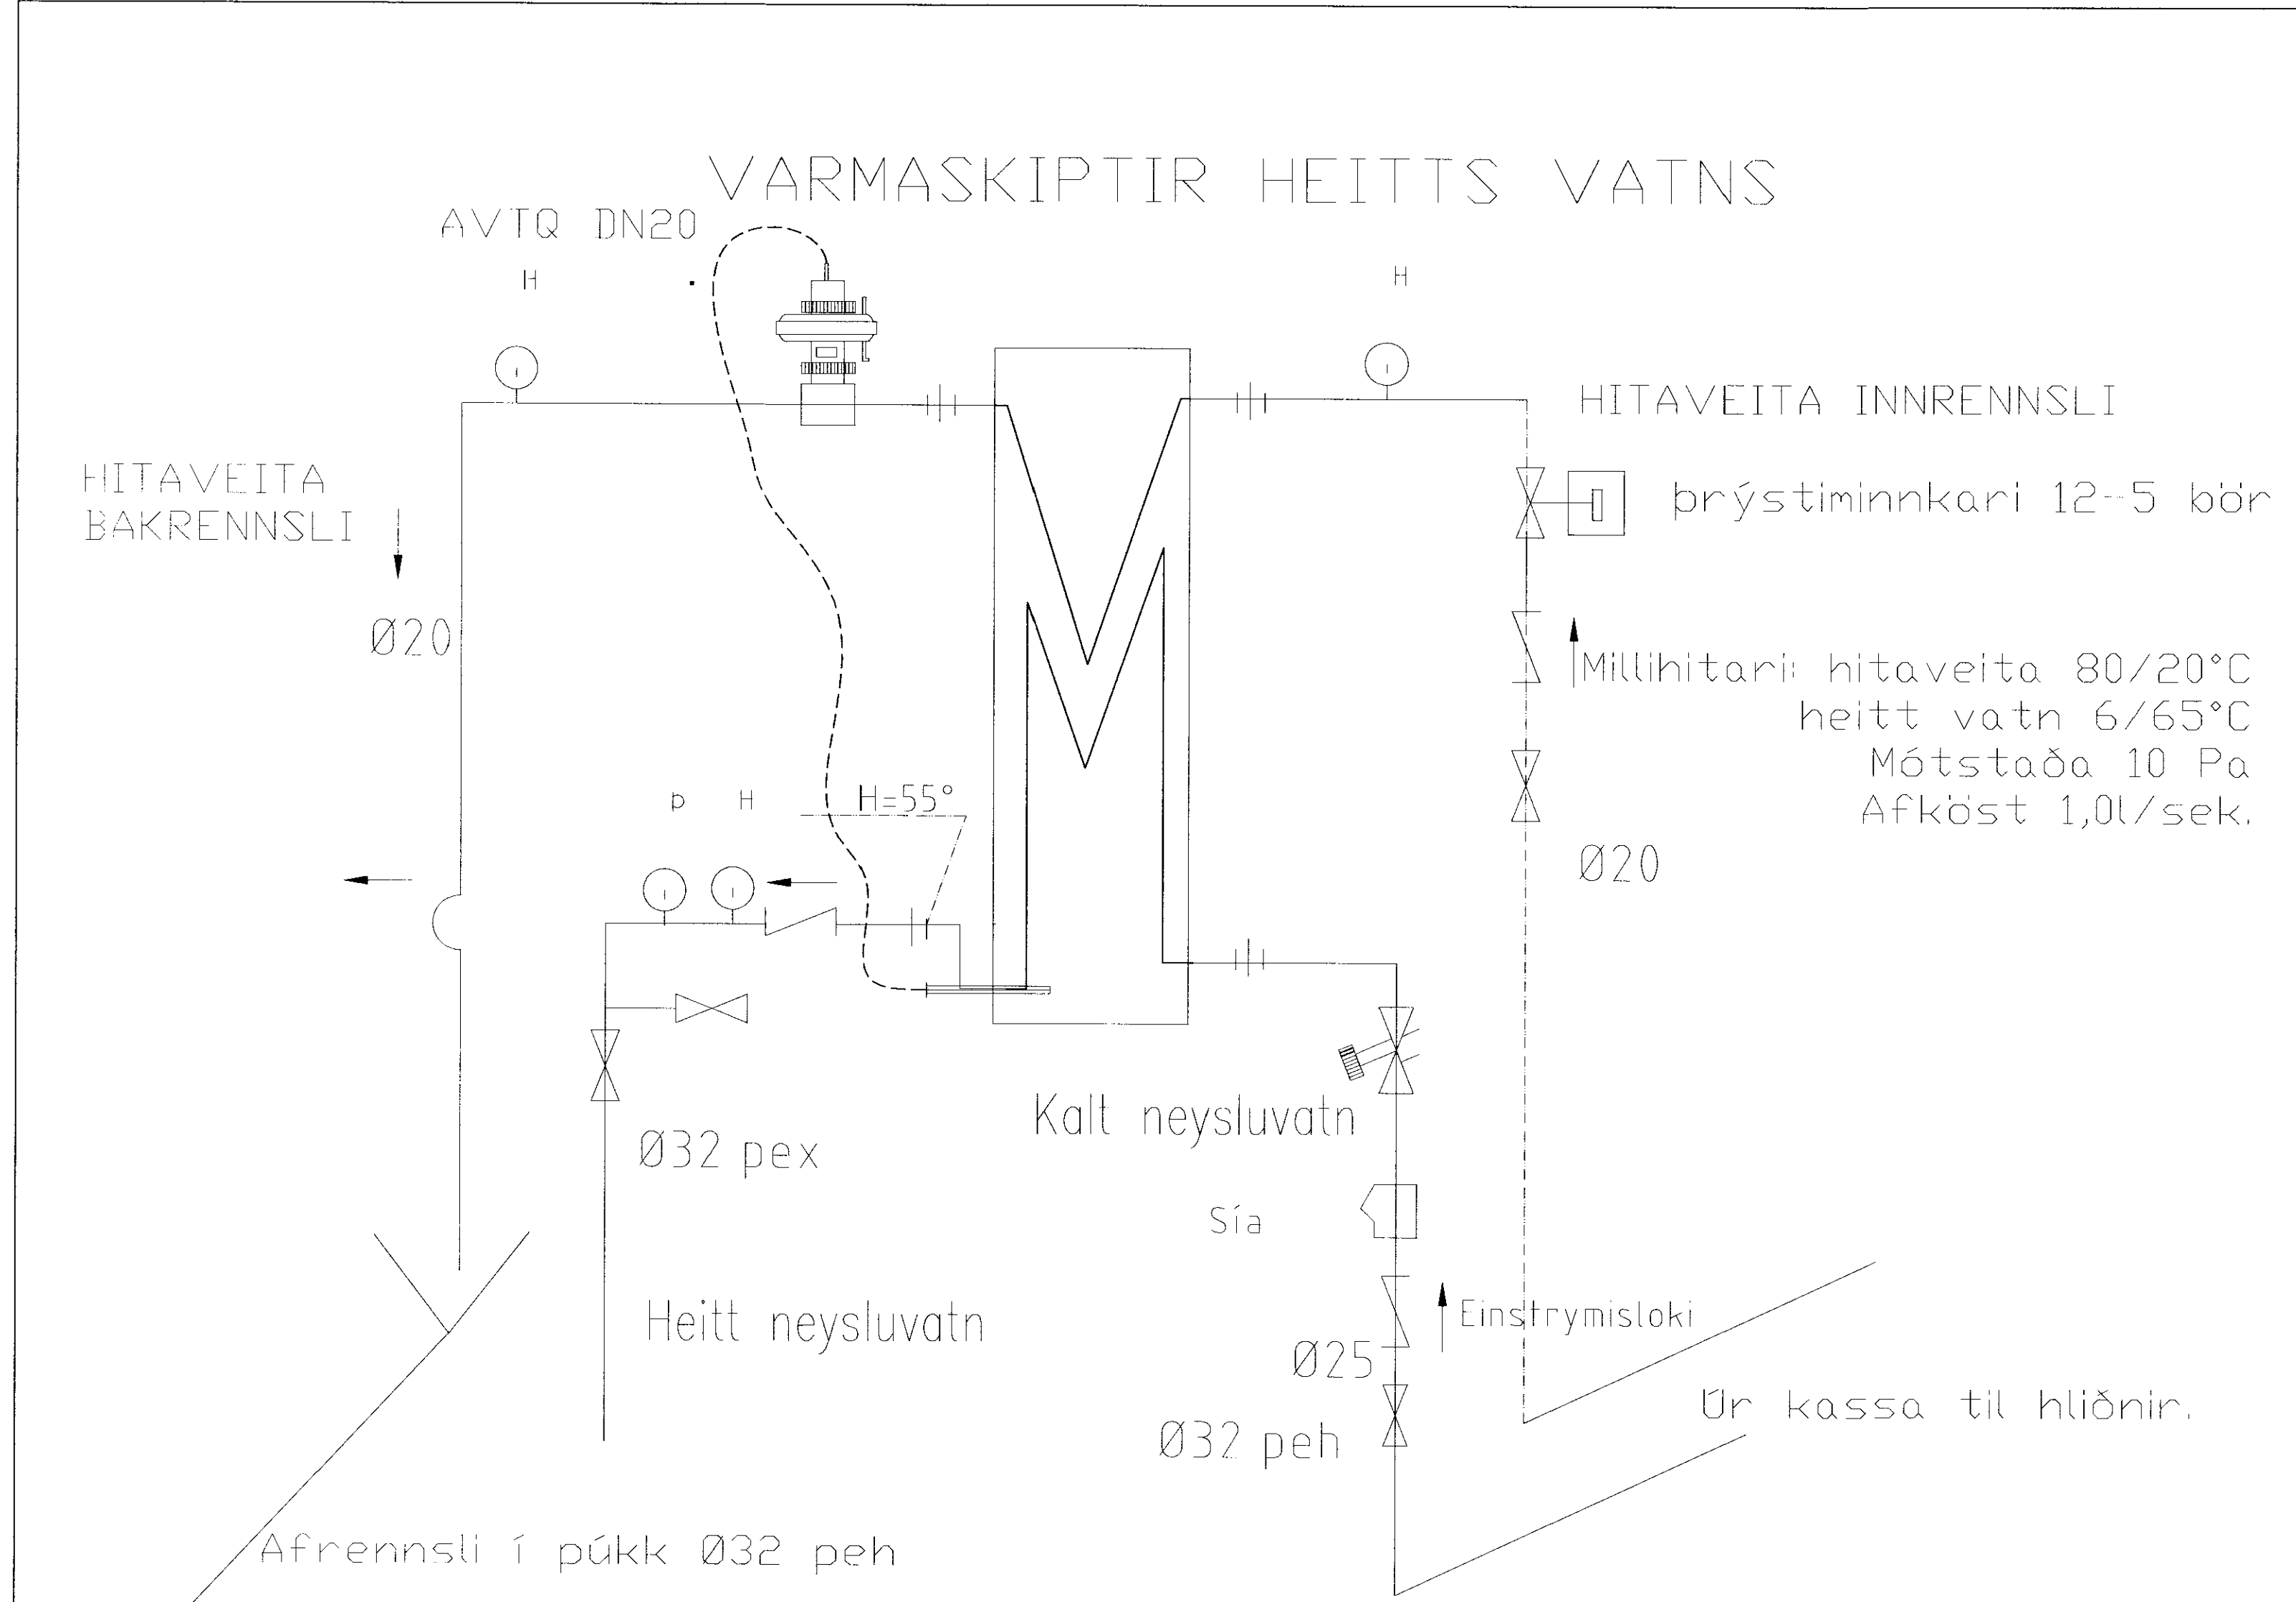

HITAVEITA INNRENNSLI
 prýstiminnkari 12-5 bör
 Millihitari: hitaveita 80/20°C
 heitt vatn 6/65°C
 Mótstaða 10 Pa
 Afköst 1,0l/sek.

Ragnars Gunnarsson

Breytingar			VR Miðhúsaskógur
Nr.	Dags.	Nafn	
			Tækniþjónusta Ragnars G. Gunnarssonar ehf. netfang:ragnargg@simnet.is
			Smíðjuvegi 11 sí: 544 5350 fax: 544 5350
			Mkv. <i>nan</i>
			Nr. 14.
			Dags 2011.06.21.
			Inntaksmynd af millihitara í umsjónarmanna húsi.
			kt.:110947-2839

Ragnars Gunnarsson