




GRUNNMYND MKV. 1:50  
HLUTI 3

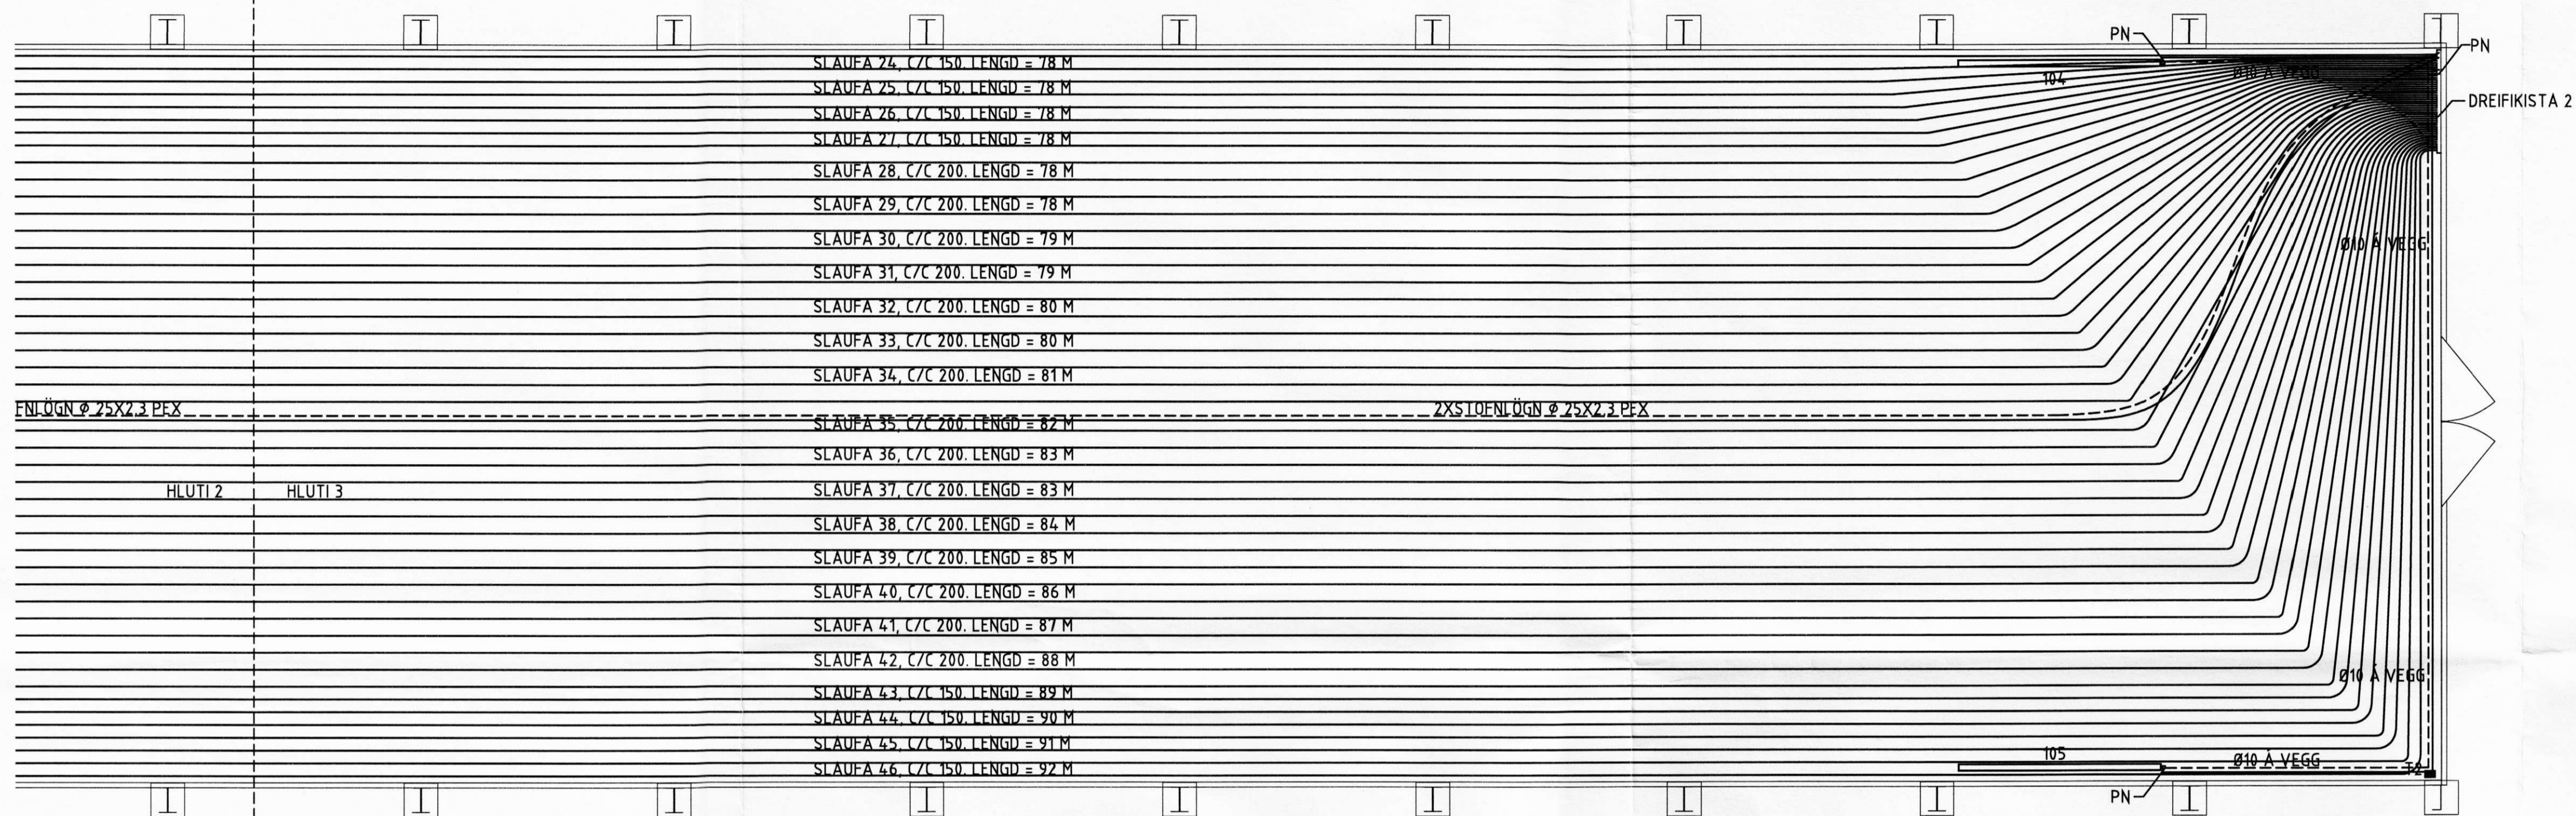

**Gólfriti**

Tengigrind 2

Slaufa nr.	Afköst [W]	Bil milli lagna [mm]	Lengd [m]	Hebergishiti [°C]	Vatnsmagn [l/min]	Stýring
24	1281	150	78	32	2,29	T2
25	1281	150	78	32	2,29	T2
26	1281	150	78	32	2,29	T2
27	1281	150	78	32	2,29	T2
28	1560	250	78	32	2,80	T2
29	1560	250	78	32	2,80	T2
30	1580	250	79	32	2,83	T2
31	1580	250	79	32	2,83	T2
32	1600	250	80	32	2,87	T2
33	1600	250	80	32	2,87	T2
34	1620	250	81	32	2,90	T2
35	1640	250	82	32	2,94	T2
36	1660	250	83	32	2,97	T2
37	1660	250	83	32	2,97	T2
38	1680	250	84	32	3,01	T2
39	1700	250	85	32	3,05	T2
40	1720	250	86	32	3,08	T2
41	1740	250	87	32	3,12	T2
42	1760	250	88	32	3,15	T2
43	1461	150	89	32	2,62	T2
44	1478	150	90	32	2,65	T2
45	1494	150	91	32	2,68	T2
46	1510	150	92	32	2,71	T2

Samtals 35.726  
Reiknuð þörf er 50.288 W

1907 64,01

T = hitastillir á vegg, stýrir samsvarandi mótorkokum

ÁRITUN ADALHÖNNUÐAR KT

ALMENNAR SKÝRINGAR SJÁ TEIKNINGU NR. -3-01

NR. DAGS. BREYTING SAMB.



**REYKJAGARÐUR** ÁSMUNDARSTADIR  
ELDISHÚS, NÝBYGGING 1  
HITA- OG ÞRIFAKERFI  
GRUNNMYND, HLUTI 3

MKV 1:50 TEKN EM 25/4 06 TEKN NÚMÉR 1085-3-04  
ÁRITUN HÖNNUÐAR KT SAMBYKKT  
HÖNNUÐUR BREYTINGAR DAGS BREYTINGAR BREYTING NR.