



GRUNNMYND MKV. 1:50  
HLUTI 1

GRUNNMYND MKV. 1:50  
HLUTI 2

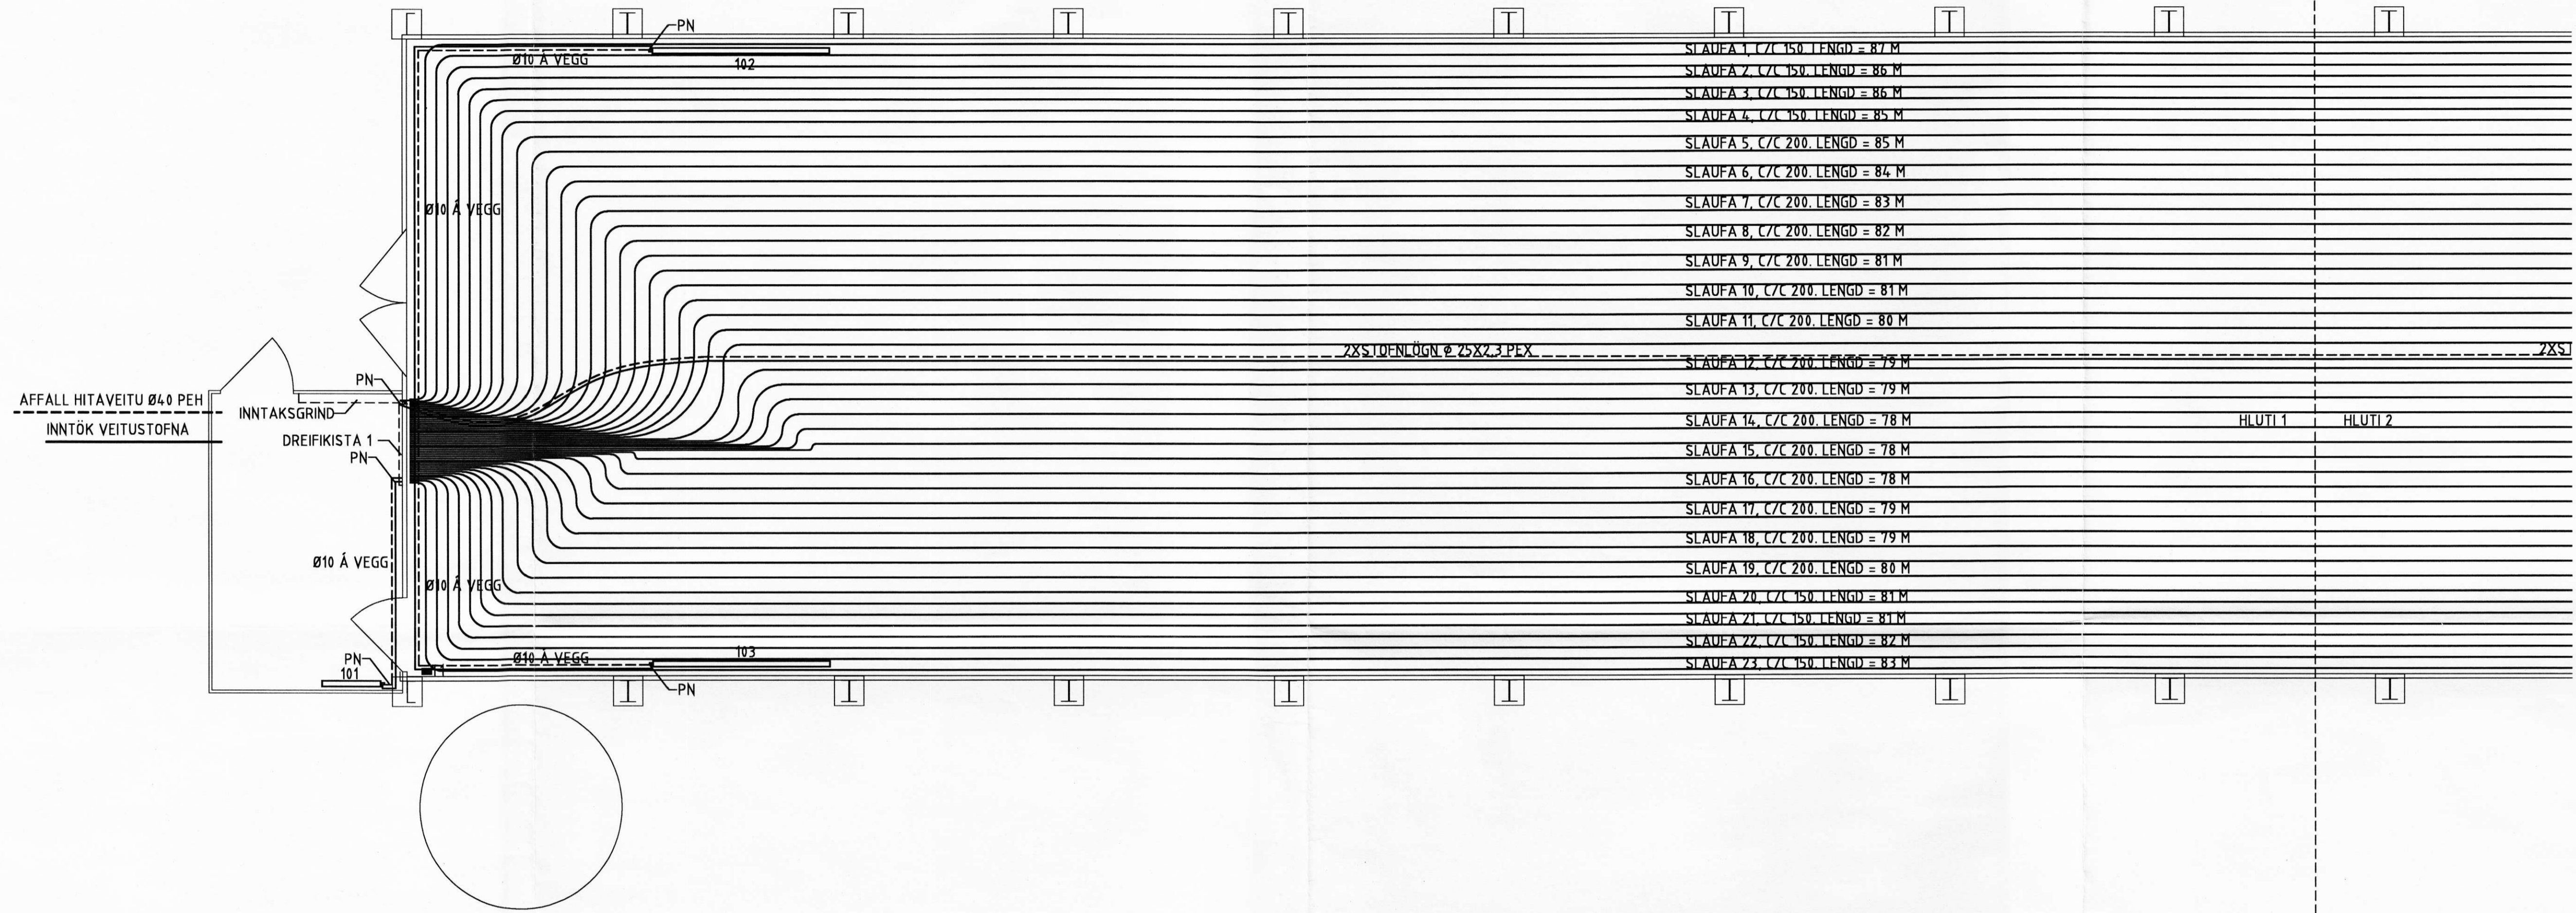

SNID Í GÓLFHITALÖGN 1. HÆÐ, MKV. 1:10

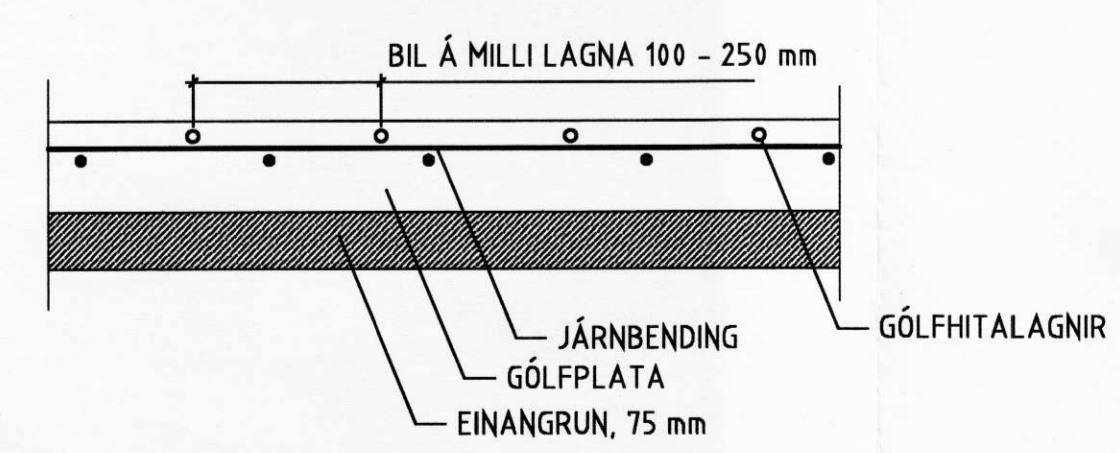

Gólfhiti						
Tengigrind 1						
Slaufa nr.	Alkóst [W]	Bil milli lagna [mm]	Lengd [m]	Herbergishiti [°C]	Vatnsmagn [l/min]	Stýring
1	1428	150	87	32	2,56	T1
2	1412	150	86	32	2,53	T1
3	1412	150	86	32	2,53	T1
4	1396	150	85	32	2,50	T1
5	1700	250	85	32	3,05	T1
6	1690	250	84	32	3,01	T1
7	1690	250	83	32	2,97	T1
8	1640	250	82	32	2,94	T1
9	1620	250	81	32	2,90	T1
10	1620	250	81	32	2,90	T1
11	1800	250	80	32	2,87	T1
12	1590	250	79	32	2,83	T1
13	1590	250	79	32	2,83	T1
14	1590	250	78	32	2,80	T1
15	1590	250	78	32	2,80	T1
16	1590	250	78	32	2,80	T1
17	1590	250	79	32	2,83	T1
18	1590	250	79	32	2,83	T1
19	1800	250	80	32	2,87	T1
20	1330	150	81	32	2,38	T1
21	1330	150	81	32	2,38	T1
22	1346	150	82	32	2,41	T1
23	1363	150	83	32	2,44	T1
<b>Samtals</b>	<b>35.136</b>		<b>1877</b>		<b>62,95</b>	
<b>Reiknuð þörf er 50.288 W</b>						

T = hitastíllir á vegg, stýrir samsvarandi mótrolukum

ÁRTUN ABALHÖNNUÐAR: KT

ALMENNAR SKÝRINGAR SJÁ TEIKNINGU NR. -3-01

NR.	DAGS.	BREYTING	SAMB.



**REYKJAGARDUR** ÁSMUNDARSTADIR  
ELDISHÚS, NÝBYGGING 3  
HITA- OG ÞRIFAKERFI  
GRUNNMYND, HLUTI 1  
SNID, GÓLFHITASKRÁ

MKV 1:10, 1:50	TEKN GP	DAGS ÚTG 30.10.06	TEIKN NÚMÉR 1114-3-02
ÁRTUN HÖNNUÐAR KT	SAMBÝKKT KT21260-4689		SAMBÝKKT
HÖNNUÐUR BREYTINGAR	DAGS BREYTINGAR	BREYTING NR	