


GRUNNMYND MKV. 1:50
HLUTI 3

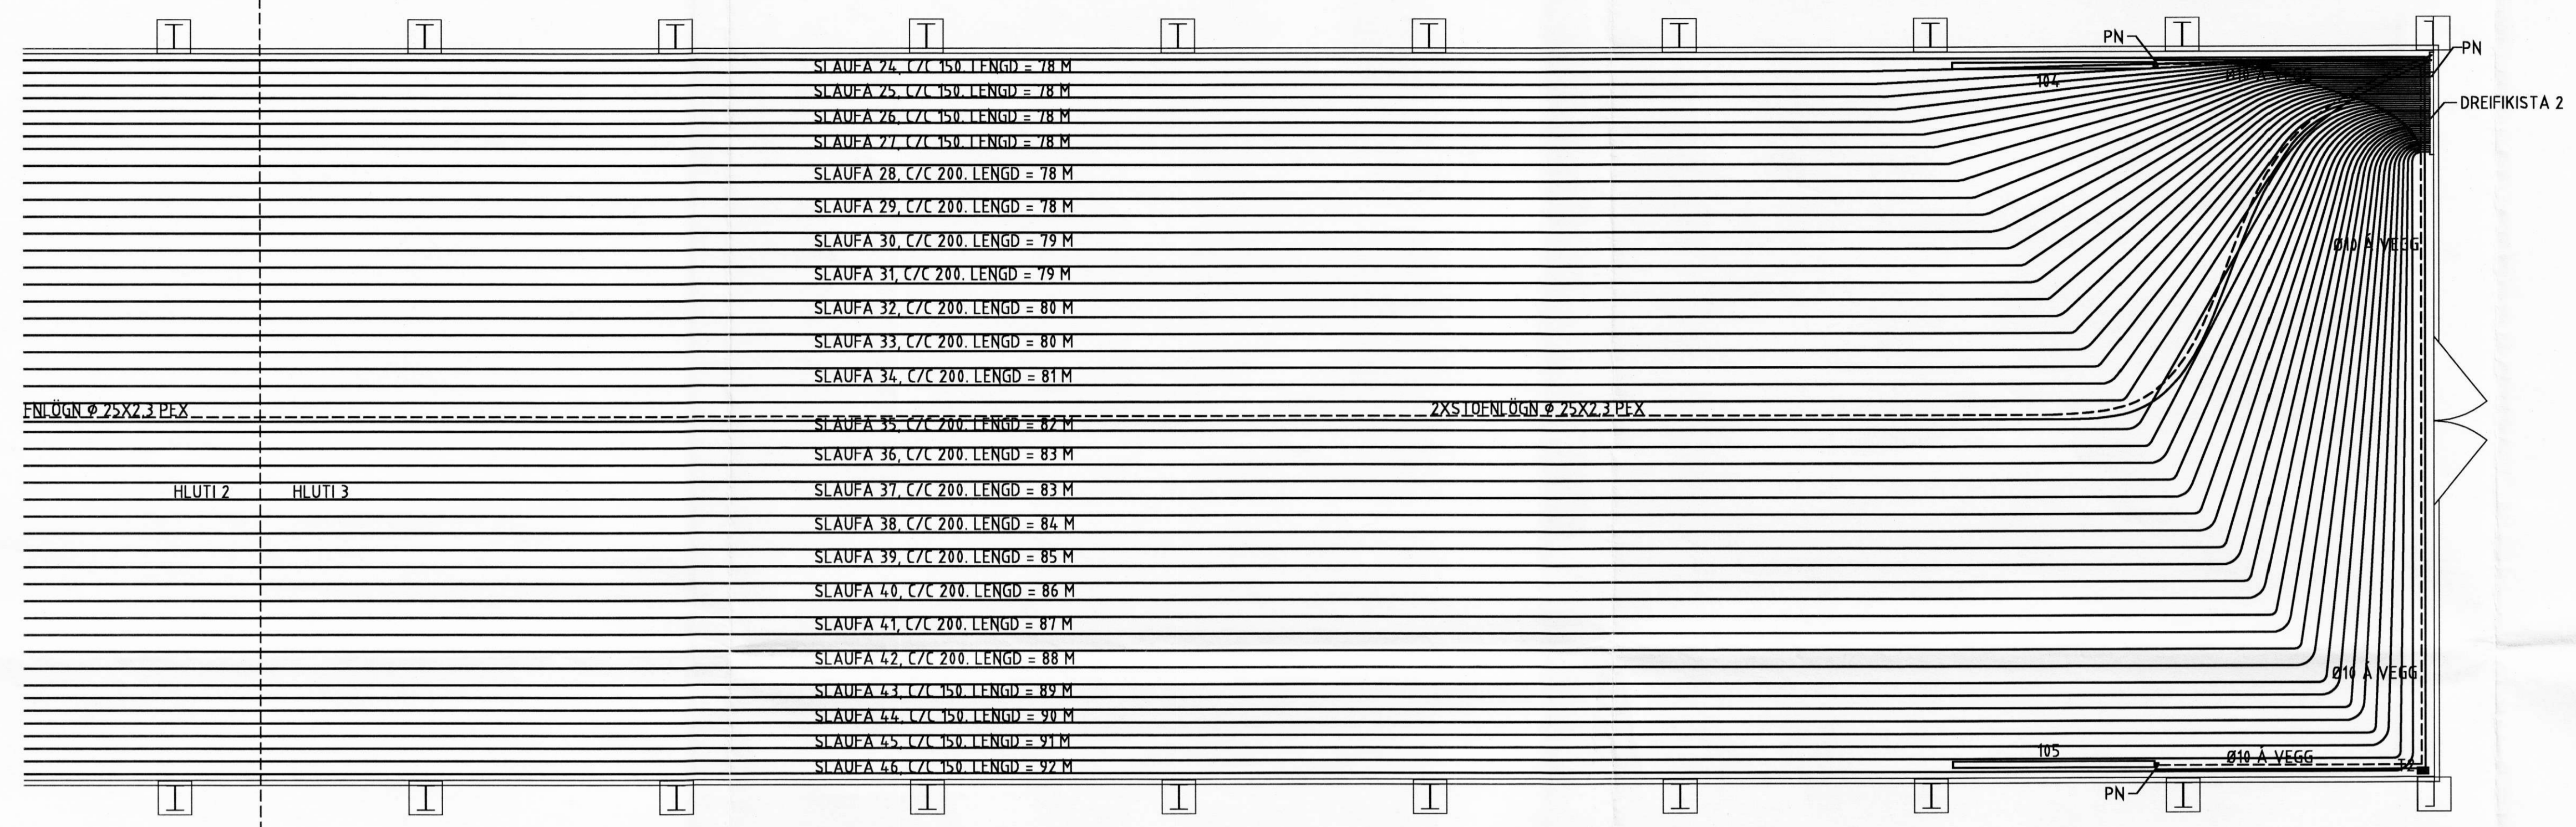

Gólfhiti

Tengigrind 2

| Slaufa nr. | Afköst [W] | Bli milli lagna [mm] | Lengd [m] | Herbergshiti [°C] | Vatnsmagn [l/min] | Stýring |
|----------------|---------------|----------------------|-------------|-------------------|-------------------|---------|
| 24 | 1281 | 150 | 78 | 32 | 2,29 | T2 |
| 25 | 1281 | 150 | 78 | 32 | 2,29 | T2 |
| 26 | 1281 | 150 | 78 | 32 | 2,29 | T2 |
| 27 | 1281 | 150 | 78 | 32 | 2,29 | T2 |
| 28 | 1580 | 250 | 78 | 32 | 2,80 | T2 |
| 29 | 1580 | 250 | 78 | 32 | 2,80 | T2 |
| 30 | 1580 | 250 | 79 | 32 | 2,83 | T2 |
| 31 | 1580 | 250 | 79 | 32 | 2,83 | T2 |
| 32 | 1600 | 250 | 80 | 32 | 2,87 | T2 |
| 33 | 1600 | 250 | 80 | 32 | 2,87 | T2 |
| 34 | 1620 | 250 | 81 | 32 | 2,90 | T2 |
| 35 | 1640 | 250 | 82 | 32 | 2,94 | T2 |
| 36 | 1660 | 250 | 83 | 32 | 2,97 | T2 |
| 37 | 1660 | 250 | 83 | 32 | 2,97 | T2 |
| 38 | 1680 | 250 | 84 | 32 | 3,01 | T2 |
| 39 | 1700 | 250 | 85 | 32 | 3,05 | T2 |
| 40 | 1720 | 250 | 86 | 32 | 3,08 | T2 |
| 41 | 1740 | 250 | 87 | 32 | 3,12 | T2 |
| 42 | 1760 | 250 | 88 | 32 | 3,15 | T2 |
| 43 | 1461 | 150 | 89 | 32 | 2,62 | T2 |
| 44 | 1478 | 150 | 90 | 32 | 2,65 | T2 |
| 45 | 1494 | 150 | 91 | 32 | 2,68 | T2 |
| 46 | 1510 | 150 | 92 | 32 | 2,71 | T2 |
| Samtals | 35.726 | | 1907 | | 64,01 | |

Reiknuð þörf er 50.288 W

T = hitastillir á vegg, stýrir samsvarandi mótorkokum

ÁRITUN ADALHÖNNUBAR KT

ALMENNAR SKÝRINGAR SJÁ TEIKNINGU NR. -3-01

| NR. | DAGS. | BREYTING | SAMP. |
|-----|-------|----------|-------|
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |



REYKJAGARÐUR ÁSMUNDARSTADIR
ELDISHÚS, NÝBYGGING 3
HITA- OG ÞRIFAKERFI
GRUNNMYND, HLUTI 3

| | | | |
|-----------------------|---------------------|-----------------------|-------------------------|
| MKV 1:50 | TEKN GP | DAGS ÚTG. 30.10.06 | TEKN NÚMÉR 1114-3-04 |
| ÁRITUN HÖNNUBAR KT | HÖNNUBUR BREYTINGAR | DAGS BREYTINGAR | BREYTING NR. |